

# Can Digitalization Improve Public Services? Evidence from Innovation in Energy Management

ROBYN MEEKS\*  
JACQUELYN PLESS†  
ZHENXUAN WANG‡

June 13, 2025

## Abstract

Electricity grids form the backbone of modern economies, but the utilities responsible for maintaining them face new energy management challenges associated with both aging infrastructure and climate change. Growing evidence suggests that digital technologies and data-driven decision-making may improve firm performance. However, existing work focuses on the private sector. Organizations providing public services have different incentives and constraints. In this paper, we narrow this gap through a study of the U.S. power sector. We construct a rich utility-level data set and estimate the effects of “smart” meters on electricity losses, a key indicator of system and utility performance. Implementing an augmented staggered difference-in-differences design, we find that electricity losses decrease by 4-7% following smart meter deployment, on average. Utilities’ annual revenue increases by 1-2%. We show that the underlying mechanisms relate to changes in energy management. Consumption measurement and billing accuracy improve, as indicated by an increase in sales, giving utilities a clearer understanding of the system to enhance decision-making. Utilities invest in complementary organizational capital that is important for fully realizing the benefits of digitalization, such as hiring “quants.” They also offer new products, like demand response programs, which attenuates the increase in sales but does not drive the reduction in losses. Power outage duration declines, suggesting that utilities use smart meters to improve reliability by restoring service faster after disruptions. Outage frequency remains unchanged.

**Keywords:** digitalization; smart grid; energy management; electric utilities; public services

---

\*Sanford School of Public Policy, Duke University. Email: [robyn.meeks@duke.edu](mailto:robyn.meeks@duke.edu).

†Corresponding author. MIT Sloan School of Management, 100 Main Street, Cambridge, MA, 02142.  
Email: [jpless@mit.edu](mailto:jpless@mit.edu).

‡Nicholas School of the Environment and Sanford School of Public Policy, Duke University. Email: [zhenxuan.wang@duke.edu](mailto:zhenxuan.wang@duke.edu).

# 1 Introduction

Economic activity—from business and industrial operations to healthcare and transportation—hinges on having access to high-quality and reliable electricity. However, electricity grids in many countries are aging and increasingly susceptible to disruptions. Power outages in the United States now cost between \$28 and \$169 billion annually (ASCE 2021). Although severe weather is often at play, poor power quality and reliability are also caused by other factors, like equipment failure and inadequate upgrading (EIA 2021; Malik 2024). Grid resilience thus depends crucially on the performance of electric utilities—the companies responsible for maintaining the system and delivering power to consumers. Improving grid management will be increasingly important moving forward. In an effort to mitigate climate change, deployment of renewable energy sources with variable output and electrification of end-use products are accelerating. These shifting dynamics are intensifying demands on the system and introducing new challenges for utilities.

Digitalization is often considered an important part of the solution. “Smart grid” technologies that provide granular, real-time data and automation capabilities can now—at least in theory—help utilities optimize operations, monitor system performance, develop more accurate demand forecasts, and improve system flexibility (Joskow 2012). However, despite the hundreds of billions of dollars spent each year globally on modernizing electricity grids (IEA 2023), whether digitalization delivers on its promises remains contentious.<sup>1</sup> The benefits depend on how utilities actually *use* the technology, but research remains thin.

In fact, little is known about the effects of digitalization on public services more generally. A flourishing literature is finding that digital technologies and data-driven decision-making can enhance firm performance in the private sector (Brynjolfsson and Hitt 2003; Bartel, Ichniowski and Shaw 2007; Brynjolfsson and Saunders 2013; Brynjolfsson and McElheran 2016; Goldfarb and Tucker 2019; Brynjolfsson, Jin and McElheran 2021b; Bar-Gill, Brynjolfsson and Hak 2024). Previous findings may not transfer, however, as organizations providing public services—like utilities, hospitals, and schools—operate under different

---

<sup>1</sup>Many utilities are not fully exploiting the technology’s capabilities and therefore not accruing all of the potential benefits (Gold, Waters and York 2020). Smart meters also can empower consumers to better manage electricity use and reduce their bills, but less than 3% of meters funded by the American Recovery and Reinvestment Act had real-time data features enabled a decade after installation (Utility Dive 2022).

conditions. For example, they often face different market forces (e.g., less competition), bureaucratic processes, and budgetary constraints, which can impact investments and innovative activity. Moreover, the benefits of complex information technologies (like smart grids) often depend on parallel investment in complementary organizational capital, such as new business processes and skills (Brynjolfsson and Hitt 2000; Bresnahan, Brynjolfsson and Hitt 2002; Bloom, Sadun and Van Reenen 2012; Brynjolfsson, Rock and Syverson 2021a).

In this paper, we provide evidence as to how digitalization impacts public service provision through a study of the U.S. electricity sector. We examine the effects of electric utilities’ deployment of smart meters, important components of advanced metering infrastructure (AMI), on utility performance and service quality across the U.S. from 2007 through 2017. Utilities historically relied on analog meters that were developed in the 1800s to track electricity consumption, requiring in-person readings and providing only sparse, imprecise data. Investments in AMI accelerated about 15 years ago, though, entailing substantial public and private expenditures, and the industry is now going through a “digital revolution.” Approximately 119 million smart meters were installed in the U.S. as of 2022 (EIA 2022).<sup>2</sup>

Smart meters remotely transmit high-resolution data on consumption, power quality, outages, and more that can help utilities reduce operational costs and enhance billing accuracy, forecasting, asset and load management, and system monitoring. These are important aspects of energy management that impact utility performance, and in turn, quality of service. Smart meters also can improve reliability if utilities use the information provided on power outage location to restore service faster. Outage frequency may even decline.<sup>3</sup>

Estimating the causal effects of digitalization on public services is empirically challenging for multiple reasons. First, technology adoption may be driven by endogenous organization and market characteristics, such as providers’ resources and local economic growth. To address endogeneity concerns, we augment a staggered difference-in-differences design with a two-stage least squares (2SLS) approach. Our method is akin to the one developed in Freyaldenhoven, Hansen and Shapiro (2019), which removes the potential effects of pre-trends

---

<sup>2</sup>This is approximately 72% of total U.S. electric meters (EIA 2022). See Strong (2018) for details of smart meters early diffusion among U.S. electricity utilities.

<sup>3</sup>For example, if utilities are able to smooth demand throughout the day with the tools that are enabled by smart meters—such as demand response programs—outages related to excess demand may decrease.

by instrumenting a covariate that proxies for confounders with leads of the treatment.

Second, studying public services is particularly difficult due to challenges with measuring service quality, especially doing so systematically for all providers within an industry.<sup>4</sup> The U.S. electricity sector provides a unique setting to overcome this limitation. Utilities serve (just about) all electricity customers and are required to report standardized information annually to the U.S. Energy Information Administration (EIA). We combine numerous data sets from the EIA for the years 2007 through 2018—the time period over which AMI investments took off—that include detailed information on operations, services, and smart meter installations for all utilities in the U.S. We also transcribed within-utility feeder line level data on power outages in Texas from Public Utility Commission reports to study reliability.

We start by examining the effects of smart meters on electricity losses, a key indicator of utility performance. Each year, about 5-6% of electricity that is generated in the U.S. is lost during transmission and distribution, which translated into more than \$6 billion in lost revenue for utilities in 2020 (Shadle 2022). Losses are calculated as the difference between power supplied to the grid and that for which customers are billed, and the loss *rate* is the proportion of power that is lost. Although losing some power is unavoidable due to the physical properties of electrical systems, high losses usually reflect inefficiencies. For example, unbilled consumption can result from incorrect meter readings or electricity theft (e.g., meter tampering). Losses also increase as equipment ages, so they may reflect inadequate upgrading, increasing exponentially with voltage fluctuations when the system is overloaded (i.e., demand exceeds capacity). This is a complex relationship, as power quality and reliability can both contribute to, and be exacerbated by, high losses.<sup>5</sup>

We find strong evidence that smart meter deployment improved utility performance. On average, loss rates decreased by 3.8% relative to the pre-treatment mean. When omitting utilities in the bottom quartile of the pre-treatment loss rate distribution—initially high-performers that had little room to improve—we find a 5% decline. The improvements also grow over time. After three years, loss rates are 5.8% lower for utilities that deploy smart

---

<sup>4</sup>For example, healthcare studies frequently examine mortality as a proxy for quality, but deaths may occur even with high-quality care. Other measures could include the time doctors spend with patients or diagnosis accuracy. Furthermore, a lot of research focuses on hospitals, which is just one type of provider.

<sup>5</sup>Power quality is lower when voltage is low (e.g., flickering or dimming of lights), and since voltage fluctuations can contribute to losses, high losses could reflect a poorer quality of power for end-users.

meters on average and 6.7% lower when omitting initially “high-performers.” These results are consistent with how it can take time for the benefits of AMI to accrue, as improvements may scale with the proportion of meters replaced, and utilities may need to develop new business processes and skills necessary to operationalize the technology’s functionalities.

Utilities also benefit from revenue gains. On average, revenue increased by 0.9% for utilities that deployed AMI relative to their pre-treatment mean and by 1.4% when restricting the sample to those that were lower performers at baseline. After three years, the increases grow to 1.7% and 2.2%, respectively, translating into \$2.4 to \$3.1 million in additional annual revenue per utility.

We probe the underlying channels of our results and find evidence of four mechanisms. First, consumption measurement and billing accuracy improve, as indicated by an increase in sales per customer.<sup>6</sup> Sales increase if utilities use AMI to address bill non-payment and electricity theft, benefits that utilities commonly report ([U.S. Department of Energy 2016a](#)). Analog meters also may have been under-reporting actual usage given how they slow down as they age. Replacing many old meters with digital ones can significantly increase sales. Although these results imply higher electricity bills (all else equal), customers may value having a more accurate account of their energy usage, reflecting a higher quality of service. Enhanced accuracy also provides utilities with opportunities to improve important aspects of energy management—such as demand forecasting, load management and proactive maintenance—which in turn, can reduce technical losses.

Second, we find that the likelihood that utilities start offering new products like dynamic pricing and demand response programs increased, reflecting efforts to implement more sophisticated load management practices that could ultimately improve service quality and grid resilience. The increase in sales per customer that emerges with AMI deployment is also attenuated when utilities offer these products. At the same time, we do not find that introducing these products drives the loss reductions. This could be because the proportion of customers using the products during our sample period is low, though, so there could be potential for doing so with greater consumer uptake.

---

<sup>6</sup>Decreases in sales also could have signalled performance improvements. For example, sales could decrease if customers use information from their smart meters to reduce consumption (and thus their electricity bills), which could also help utilities’ load management.

Third, to further investigate whether utilities make energy management adjustments, we examine the composition of the utility sector’s local workforce. Integrating smart technologies and leveraging their capabilities to improve decision-making requires workers with different skills relative to those required for manually reading traditional meters. Using Occupational Employment and Wage Statistics data provided by the U.S. Bureau of Labor Statistics, we find a reduction in meter readers with AMI deployment along with an increase in the number of “quants” (e.g., computer scientists who are equipped with the skills required to analyze data and improve energy system modelling). These results are consistent with utilities making organizational investments that can enhance the benefits of digitalization.

Fourth, we examine whether reliability improves using within-utility data on power outages in Texas. We find that outage duration decreased by 6.8-7.8% following AMI deployment on average, suggesting that utilities use smart meters to restore power faster, consistent with improved energy management.<sup>7</sup> However, we find no change in outage frequency, suggesting that additional capabilities or other solutions may be needed to avoid outages altogether.

Taken together, our findings indicate that digitalization can enhance utility performance and service quality through energy management improvements. Complementary organizational capital is likely important for maximizing the benefits, which raises the question of which utilities invest in new business processes and skills. We explore this by examining whether there is heterogeneity across ownership type. Utilities can be either government- or privately-owned, resulting in different incentives and constraints (Hart, Shleifer and Vishny 1997; Shleifer 1998; Duggan 2000), and utilities’ technology adoption decisions may differ by ownership type (Rose and Joskow 1990).<sup>8</sup> For example, investor-owned utilities face pressure to generate short-term returns for shareholders, which incentivizes efficiency but may come at the expense of longer-run investments that serve public interests (Flammer and Bansal 2017). Government-owned utilities may have longer time horizons and be more likely to prioritize social objectives because their customers are their constituents. Consistent with this line of reasoning, we find that loss rate improvements are driven by government-owned utilities. Differences in other utility characteristics do not account for the heterogeneity.

---

<sup>7</sup>Smart meters notify utilities immediately when outages occur, allowing utilities to respond faster. More detailed data also helps utilities identify the cause and its location so they can solve the issue quicker.

<sup>8</sup>Privately-owned utilities include investor-owned utilities and cooperatives.

## 2 Related Literature and Contributions

This paper speaks to four main sets of literature. First, most specifically, we provide new evidence as to whether (and how) digitalization can improve electric utility performance and service quality. Ensuring access to high-quality and reliable electricity is first-order for fostering modern economic activity and quality of life. When the power goes out, schools shut down, traffic lights stop working, and life-sustaining medical equipment no longer functions. However, electricity infrastructure is deteriorating in many countries, and utilities are facing rising costs along with new energy management challenges. The share of energy supply coming from intermittent renewable resources—which must be balanced with demand in real time—and electrification of end-use products (e.g., vehicles) are increasing, putting more pressure on the grid and requiring new capabilities from utilities.

With these shifting market dynamics and the need to transition to a cleaner, more sustainable economy, understanding how to manage the grid efficiently is more crucial than ever. Although experts agree on the need for significant grid investment—and policymakers carved out \$13 billion for grid modernization in the 2022 Infrastructure Investment and Jobs Act—large-scale empirical studies of how smart meters impact service provision and utility performance have been missing.<sup>9</sup> On the consumer side, [Brandon, Clapp, List, Metcalfe and Price \(2022\)](#) and [List, Metcalfe and Price \(2018\)](#) examine how smart technology impacts energy use in the U.S. and U.K., finding no significant effects. A related but distinct literature examines whether interventions *facilitated* by smart meters, like providing information and introducing new pricing designs, impact *consumption* ([Wolak 2011](#); [Jesoe and Rapson 2014](#); [Ito, Ida and Tanaka 2018](#); [Bollinger and Hartman 2020](#); [Burkhardt, Gillingham and Kopalle 2023](#); [Blonz, Palmer, Wichman and Wietelman forthcoming](#)). To the best of our knowledge, we are the first to examine how utilities use these digital technologies to improve energy management and the impacts on system performance and service quality.

Research on the economics of electricity resiliency in developed countries also remains scant ([Borenstein, Bushnell and Mansur 2023](#)).<sup>10</sup> The emerging literature includes two

---

<sup>9</sup>The American Recovery and Reinvestment Act of 2009 provided \$4.5 billion for smart grid investments.

<sup>10</sup>There is a more extensive literature on reliability in developing countries ([Fisher-Vanden, Mansur and Wang 2015](#); [Trimble, Kojima, Arroyo and Mohammadzadeh 2016](#); [Allcott, Collard-Wexler and O’Connell 2016](#); [Zhang 2018](#); [Carranza and Meeks 2021](#); [Meeks, Omuraliev, Isaev and Wang 2023](#); [Berkouwer, Biscaye,](#)



working papers examining technology adoption to study the value of reliability (Bollinger, Gillingham, Darghouth and Gonzalez-Lira 2023; Brown and Muehlenbachs 2023).

Second, more broadly, our paper contributes to the quickly-evolving literature studying how digitalization and data-driven decision-making impacts organization performance. Research related to the adoption of information and communications technologies dates back to at least the 1990s (see Draca, Sadun and Van Reenen (2009) and Goldfarb and Tucker (2019) for reviews). With managers having access to increasingly vast amounts of data, this literature continues to evolve, but the focus primarily has been on firms in the private sector (Brynjolfsson and Hitt 2000; Bresnahan et al. 2002; Brynjolfsson and Hitt 2003; Bartel et al. 2007; Bloom et al. 2012; Brynjolfsson and Saunders 2013; Brynjolfsson and McElheran 2016; Goldfarb and Tucker 2019; Brynjolfsson et al. 2021ab; Bar-Gill et al. 2024).

Whether digitalization improves public services has gone relatively under-studied despite their crucial role in maintaining well-functioning economies and high standards of living. Healthcare is one exception (see Bronsoler, Doyle and Van Reenen (2022) for a review), but this literature tends to face two key limitations that we are able to overcome by studying the electricity sector. First, quality of services is notoriously difficult to measure. Mortality is a commonly-used indicator, which captures an important outcome that may be correlated with quality of service but does not measure quality of service directly.<sup>11</sup> By studying electricity service providers, we are able to use precise, objective, and systematically reported indicators of performance and service quality. The second challenge is that data restrictions often lead researchers to studying a specific type of provider (e.g., hospitals as opposed to all physicians and specialists) and therefore a select set of customers (e.g., inpatients). With our data, we can study nearly all service providers across an entire industry within a country.

The third line of research to which our paper contributes relates to how management shapes organization performance. Similar to the digitalization literature—and perhaps even more so—most research in this space focuses on the private sector. In addition to early case studies and descriptive analyses of firms’ management practices, an extensive empirical evidence base documenting the importance of management quality for firm performance has

---

Mikdash, Puller and Wolfram 2024), but the challenges (and therefore solutions) are fundamentally different.

<sup>11</sup>People may pass away because of their conditions even if the quality of service is perfect. Some measures of service quality itself might include time spent with patients, diagnosis processes and accuracy, etc.



emerged with the availability of large-scale microdata (Bloom and Van Reenen 2007; Bloom, Brynjolfsson, Foster, Jarmin, Patnaik, Saporta-Eksten and Van Reenen 2019; Gosnell, List and Metcalfe 2020). However, very little is known about management of public services. A related nascent literature examines managers in the public sector (Janke, Propper and Sadun 2019; Otero and Munoz 2022; Fenizia 2022), but individual attributes and organization-level practices are two separate channels through which management impacts performance (Metcalfe, Sollaci and Syverson 2023). Bloom, Lemos, Sadun and Van Reenen (2020) and Bloom, Propper, Seiler and Van Reenen (2015a) study the role of location and competition for hospital performance and management, respectively, but not the effects of management on services. Bloom, Lemos, Sadun and Van Reenen (2015b) show that higher management quality in schools is correlated with better student outcomes, but data limitations prohibit a causal analysis.

Lastly, we provide new insights on public versus private provision of services. Understanding the implications of firm ownership is a long-standing issue in economics and private provision of *public* services is particularly controversial. However, research to date mostly focuses on financial outcomes.<sup>12</sup> We do not estimate the effects of privatization, but we add to this literature by documenting heterogeneity in the effects across ownership type, which provides insight into the importance of managerial incentives for realizing the benefits of digitalization. That is, although privately-owned utilities have incentives and requirements to improve quality of service as well, they face short-term pressures to generate financial returns for shareholders. On the other hand, when organizations have longer time horizons and focus on social objectives, their investments may generate greater performance benefits.

### 3 Background on Power Sector and Research Setting

This section provides background on our research setting, including an overview of electricity distribution systems in the U.S., the role of utilities (i.e., service providers) and energy management, indicators of utility and system performance, and how digitalization could

---

<sup>12</sup>Recent exceptions study the impact on prison inmates (Mukherjee 2021) and healthcare consumers (Bergman, Johansson, Lundberg and Spagnolo 2016; Duggan, Gupta, Jackson and Templeton 2023) but not on service quality directly.

theoretically improve performance and quality of service.

### 3.1 Electricity Distribution in the U.S.

Electric grids are complex networks that deliver power to consumers. They are comprised of high-voltage transmission lines that transfer electricity from power plants to population centers through high-voltage transmission lines (the “interstate highway” of the grid) and distribution systems that then deliver the power to end-users (residential, commercial, and industrial customers). Distribution systems include substations, transformers that reduce (“step down”) voltage to the level required for end-use appliances and equipment, lower voltage power lines (the “last mile”), meters that monitor consumption located on end-users’ premises, as well as customer services. The U.S. distribution system is expansive, serving 145 million end-users through 5.5 million miles of distribution lines (EIA 2016).

Access to high-quality and reliable electricity is important for maintaining a well-functioning economy and quality of life, but the distribution system in the U.S. is aging quickly and increasingly susceptible to disruption. Approximately 70% of transmission and distribution (T&D) lines were constructed in the early- to mid-1900s and are now in the second half of their life expectancy (ASCE 2021). Inadequately upgraded and poorly maintained infrastructure can come with serious consequences for power quality (e.g., voltage fluctuations) and reliability (i.e., outages). The distribution system is responsible for 92% of the country’s power interruptions (ASCE 2021), which are driven by a combination of aging infrastructure, severe weather, and various aspects of utility and energy management.<sup>13</sup>

Poor power quality can be disruptive and costly. Residential customers may experience low voltage and voltage fluctuations as dimming or flickering lights, but significant drops also can damage end-use products, which can be especially costly for commercial and industrial customers. Even minor voltage fluctuations can ruin expensive machinery and shut down production processes. Reliability in the U.S. also has been declining. The average customer experienced about 5.5 hours of power interruptions in 2022, up from a little over 3.5 hours in 2013, and it is far worse in some parts of the country (EIA 2024). Outages sometimes are just inconvenient but also can be life-threatening, such as when they affect electronic

---

<sup>13</sup>We expand upon the role of utilities in Section 3.2 and measurements of performance in Section 3.3.

medical devices and transportation systems.

## 3.2 Role of Utilities

Electricity distribution in the U.S. is managed by approximately 1,300 utilities that are responsible for maintaining the grid as well as selling and delivering electricity that can meet end-users' needs.<sup>14</sup> Utility performance and energy management, therefore, play a pivotal role in ensuring high-quality and reliable electricity service. Energy management entails optimizing assets and operations as well as planning, controlling, storing, and distributing electricity. Utilities also must remain fiscally sustainable by maximizing efficiency, generating revenue, and minimizing costs (e.g., distribution system upkeep and repairs, billing processes, emergency response, safety and regulatory compliance, and customer service).

Poor utility practices can lead to poor system performance and reliability. Although many outages in the U.S. are caused by extreme weather events, like storms that knock down power lines, about two hours of the power outage time per year experienced by the average U.S. customer over the last decade have been due to non-major events (i.e., causes besides extreme weather events) (EIA 2024). Non-major event outages even accounted for most down time in some states.<sup>15</sup> For example, inadequate maintenance, upgrading, and vegetation management can make the system more susceptible to disruption. Supply and demand also must be balanced in real time. Weather events, therefore, can impact system performance not just by knocking down power lines but also through utilities' capacity to manage spikes in demand due to the use of air conditioning and heat, which can lead to overload (i.e., demand exceeding capacity) and equipment malfunction. Demand growth on the horizon due to data center build-out as well as the increasing proportion of electricity supply coming from intermittent renewable resources also introduces new energy management challenges for utilities.

---

<sup>14</sup>The U.S. has more than 3,200 electric utilities when also counting those responsible for generation and transmission. Some utility activities differ if they also control those components.

<sup>15</sup>For example, this was the case for West Virginia, Maine, and several other states in 2022 (EIA 2024).

### 3.3 Electricity Losses as Key Performance Indicator

There are various ways to evaluate the performance of electricity distribution systems, which in turn, reflect utilities’ performance with respect to delivering high-quality and reliable power as well as their financial standing. We primarily focus on one of the key performance indicators set out by the Institute of Electrical and Electronics Engineering (IEEE)’s standards: electricity losses.

From the point at which electricity is generated and supplied to the T&D system to when it is consumed, some proportion of it is lost at various stages; however, the extent of losses differs across settings. Electricity losses are, therefore, often considered an important indicator of the “efficiency and financial sustainability of the power sector” (Jiménez, Serebrisky and Mercado 2014). Those occurring as electricity travels throughout transmission and distribution are referred to as line losses, calculated as the difference between the electricity supplied to the grid and the amount for which customers are billed. The loss rate—the percentage of electricity lost relative to total electricity supplied to the system—thus captures the overall efficiency of the system and performance of utilities responsible for managing it.

Transmission and distribution losses are frequently in the 6-8% range for high-income countries but can be as low as 2-3%, indicating that there is still room for improvement in many cases. For example, according to 2014 data from the World Bank, total transmission and distribution losses were 2% in Singapore, 3.4% in South Korea, and 3.9% in Germany.

Electricity losses are caused by both “technical” and “non-technical” factors. Technical losses occur naturally due to the physical properties of the system, such as conductor resistance, and mainly consist of power dissipation along distribution lines and transformers. Some degree of electricity losses are thus unavoidable. However, losses are higher when the system is poorly managed. For example, since losses increase as equipment ages, high losses could reflect a history of insufficient maintenance and upgrading. Losses are also exacerbated by factors like system overload (i.e., demand exceeding supply), which can occur if utilities do not adequately balance demand and supply or if demand unexpectedly spikes. Voltage fluctuations can exacerbate losses as well (Jiménez et al. 2014), which in turn, causes system instability or even collapse.<sup>16</sup>

---

<sup>16</sup>Furthermore, as energy losses transform into heat (they are resistance multiplied by the current squared),

“Non-technical” losses (NTLs), on the other hand, are caused by factors external to the system. They are caused by issues like illegal cable hooking—which allows people to bypass meters and consume electricity without paying for it—or incorrect electricity meter readings due to outdated and damaged technology, human error by utility workers, or meter tampering by customers. Although non-technical losses are more frequently associated with low and middle income countries—where they are indeed higher, on average—NTLs are also common in high-income countries like the U.S.

In addition to improving system efficiency for the sake of providing high-quality and reliable power to customers, reducing electricity losses is also increasingly important for utilities to remain financial viable. Electricity losses represent lost revenue, and utilities’ financial standing plays a role in determining their capacity to make system investments and provide good service. Furthermore, utilities still must pay for electricity delivered to the system even if it is not billed to or paid for by end-users, and as utilities must purchase enough to meet actual demand plus losses, the amount purchased increases with expected losses. Consumers also may bear some of the costs, as they tend to be passed through to prices or other charges on electricity bills.

### 3.4 How Digitalization Can Improve Performance

Proposals to improve electricity systems and utility performance often include modernizing the grid with digital technologies and enhanced energy management. Until the early 2010s, most electricity meters—the devices located on customers’ premises to track electricity usage, primarily for billing purposes historically—were antiquated and unsophisticated ([Munasinghe 1981](#)). The majority of customers still had conventional electro-mechanical meters that were developed in the late 1800s and predate other now obsolete technologies, such as the rotary phone ([Public Utility Commission of Texas 2010](#)). The functionality of these older meters is extremely limited. They require many tasks to be performed manually in person, such as reading meters to calculate the amount of power used during a billing period and manually disconnecting and reconnecting customers (e.g., when customers move

---

they can subsequently lead to lines stretching and sagging such that they come into contact with surrounding objects and cause a fault, which also can permanently damage the line and other equipment ([FERC 2020](#)).

or have not paid their bills). And when outages occur, utilities would rely on end-users to report them and field crews to locate and identify the outage source in person.

Recent advances in digital technologies and data generation, transmission, and storage are opening up new opportunities for utilities to improve performance and the quality of service that they provide, though. Digitalization in the electricity context entails investing in advanced metering infrastructure (AMI)—an integrated system comprised of “smart” meters installed at end user premises, a communication network (either wired or wireless) to transmit information between meters and the distribution company, and data management systems (Gold et al. 2020). Smart meters provide high-frequency electricity data—usually at least at the hourly or 15-minute level—to utilities and end-users remotely. Investments in AMI initially progressed slowly in the U.S. but increased rapidly through the 2010s. Appendix A1 provides additional institutional background on the drivers of AMI deployment in the U.S. The electricity sector’s “digital revolution” extends well-beyond the U.S. as well.<sup>17</sup>

In the paragraphs that follow, we elaborate upon the potential functions of and benefits from AMI. Although these are frequently enumerated in technological and industry reports, there is little empirical evidence as to how these functionalities are employed—and the benefits accrued as a result—by utilities in practice.

**Mechanical Benefits.** Some features of AMI technology can improve performance mechanically (i.e., with just deploying meters without additional action) and practically immediately. For example, smart meters often have the functionality to shut down grid connections automatically if voltage spikes or dips outside of the range that is safe and appropriate for end-use products and equipment. This can help prevent unplanned outages, and in turn, protect equipment from being damaged and reduce the probability of future disruptions.

**Automated Billing and O&M Costs.** Deploying smart meters can induce almost immediate cost savings and customer service benefits related to remote collection of consumption data and automating billing processes. With conventional meters, utilities incur significant labor and transportation costs associated with deploying workers to gather electricity use data onsite for billing purposes. Remote provision of consumption information and auto-

---

<sup>17</sup>In 2013 alone, approximately \$15 billion were invested in smart grids worldwide (IEA 2015).

mated billing processes can, therefore, substantially reduce billing costs.<sup>18</sup> These operational efficiency gains can be substantial and improve the customer experience, although the net effect on labor costs depends on the extent to which the utility also hires workers with other skills when shifting to AMI (e.g., computer scientists and software engineers who can analyze high-frequency data and improve dispatch models).

**Reducing Technical and Non-Technical Line Losses.** Utilities have additional opportunities to reduce technical and non-technical electricity losses when they deploy AMI. With respect to NTLs, rolling out smart meters can lead to utility workers identifying meter tampering and other forms of energy theft when replacing meters. Remote data transmission from smart meters also can reduce NTLs associated with incorrect meter readings, as it circumvents the need for estimating consumption or interpolating bills when in-person meter readings are not possible, decreasing human error in the billing process (Nangia, Oguah and Gaba 2016; Cooper and Shuster 2021). These improvements can also lead to reductions in customer complaints and faster resolution of billing disputes (U.S. Department of Energy 2016a). At the same time, if the incumbent technology consistently under-measured actual consumption, bills may increase following smart meter deployment even if actual consumption does not change. Utilities’ financial standing may therefore improve through enhanced revenue recovery, but the effects on customer satisfaction are ambiguous.<sup>19</sup>

When fully leveraging the high-frequency nature of the data generated, smart meters also can help utilities reduce technical line losses, especially if they also invest in complementary AMI technologies that provide information on power flows and quality as well as developing or acquiring the skills required for analyzing such data. The combination of more precise data with advanced analytics can allow utilities to improve energy planning and supply-demand balancing, such as by improving their demand forecasts, as well as identify consistent

---

<sup>18</sup>Indeed, this is one of the most frequently cited motivations for utility investment in AMI (U.S. Department of Energy 2016b). Prior to AMI, some utilities replaced conventional electro-mechanical meters with automatic meter reading (AMR) systems, which can broadcast consumption data within a very limited distance and permit remote disconnection (USAID 2009). These provide some operational cost savings relative to electro-mechanical meters, as employees could collect consumption data by driving around neighborhoods; however, their capabilities fall short of AMI and they still involve higher labor and transportation costs.

<sup>19</sup>It could increase satisfaction if consumers value billing accuracy or if billing errors previously created distrust. However, customers may dislike facing higher bills for the same quantity of electricity power previously consumed if old meters systematically under-measured true consumption.



bottlenecks or places where the grid is consistently constrained (Nangia et al. 2016; Gold et al. 2020). These types of insights can help inform asset optimization and investment decision-making, and in turn, lower electricity losses. Utilities also can use other AMI components in conjunction with smart meters to enhance voltage monitoring capabilities, which can reduce line losses and improve power factors (U.S. Department of Energy 2016b).

Smart meters also provide opportunities for utilities to offer new products, such as demand response programs and dynamic pricing schemes, which may enhance customer satisfaction while also providing opportunities for improving service and reducing losses as well.<sup>20</sup> Demand response programs provide utilities with greater control over supply and demand. More granular data and two-way real-time communications through smart meters can enhance their ability optimize power flows throughout the day and reduce demand during peak periods (Costa-Campi, Daví-Arderius and Trujillo-Baute 2018). Dynamic pricing schemes that set prices higher during peak demand periods also provide opportunities for achieving similar outcomes depending on consumer response (i.e., if customers shift energy use away from peak periods). Such products also empower customers to lower their electricity bills, which may enhance customer satisfaction.

**Reliability Benefits.** Lastly, utilities can use smart meters to reduce power outage duration and/or frequency, improving the reliability of service for end-users as well as the financial performance of utilities. Voltage quality data can help utilities identify potential weak points in the system or recurring bottlenecks, which can lead to reduced outages if utilities address these issues with energy planning adjustments or system upgrades. Utilities also can use smart meters to respond to outages faster when they do occur, reducing the amount of time it takes to restore power. For instance, AMI meters are often equipped with “last gasp” alarms that inform utilities immediately of service disruptions, which also then provides more precise location information to identify the outage’s original source (U.S. Department of Energy 2014c). While the alerts are mechanical through the technology’s features, the degree to which such features reduce power outage duration and the associated costs hinges

---

<sup>20</sup>These types programs could be implemented to some degree with intermediary technologies deployed prior to AMI, like automated meter reading (AMR), but the data granularity and frequency allow for much more precision.

upon utilities dispatching repair crews appropriately.<sup>21</sup>

## 4 Data and Sample Construction

We construct and use three data sets throughout this paper. The first is at the utility level, linking information on U.S. electric utilities’ performance, characteristics, and smart meter deployment, which we use for the majority of our analyses. We construct two additional data sets for exploring the mechanisms driving our results: feeder line-level data on power outages for Texas and regional-level occupation data for the U.S. This section provides an overview of the data; additional details can be found in Appendix B.

### 4.1 Smart Meter Deployment and Utility Performance

To compile utility-level data on smart meter deployment and performance, we start with data from the U.S. Energy Information Administration (EIA)’s annual census of all electric utilities in the U.S. (Form EIA-861). It includes information on smart meter deployment, performance measures such as electricity losses and sales, operational data, dynamic pricing and demand response programs, and select utility characteristics. We collect data for the years 2007 (the first year in which AMI deployment data are available) through 2017 to construct several key variables of interest.

First, we create the variables for initial smart meter deployment (our main treatment variable) and deployment rates (the intensity of treatment). We use the number of electric meters that fall within each meter type (conventional or AMI) and use the first year in which the number of AMI meters is greater than zero as the year of initial smart meter deployment. We measure deployment rate as the ratio of total AMI meters to the total number of customers. Figure 1 illustrates the significant deployment of AMI through the time period that we study.<sup>22</sup> There is very little deployment as of 2007, while the proportion of customers with AMI increases dramatically by 2017.

---

<sup>21</sup>These potential improvements are frequently reported as a motivation for smart grid investments in various government reports and on utilities’ websites (U.S. Department of Energy 2014ab; Duke Energy Progress 2020; BC Hydro 2016; Sprinz 2018).

<sup>22</sup>Note that, while we study deployment of AMI at the utility level in our regressions, the figures show deployment rates by county.

We also use EIA data to construct our utility performance measures, including the electricity loss rate (which is the percentage of total disposition that is lost through transmission and distribution), total sales and sales per customer (both in megawatt hours), revenue per customer (which reflects customers’ average annual spending on electricity bills), and revenue per unit sold (which reflects the average annual electricity price). The EIA data reports electric operating revenue from different sources, including retail sales to end-users, delivery customers, sales for resale, transmission, and other electric activities. We take the sum of these to get total revenue. Furthermore, we use these data to identify whether utilities offer products like demand response programs and dynamic pricing, including the number of customers enrolled and the year in which such services were introduced (using the first year in which there are more than zero customers enrolled).

Lastly, we gather additional information on utilities’ time-invariant characteristics like location and service territory from EIA-861, and ownership type and business scope from S&P Global Market Intelligence.

## 4.2 Service Territory Population and Housing

We use two other key pieces of information throughout our main utility-level analyses—local population and new building construction—that we collected from other sources. We obtained county-level population data from the Survey of Epidemiology and End Results (SEER) and data on new building units from the U.S. Census’ Building Permits Survey (BPS). Using the electric service territory information from EIA-861, we merge these county-level population and housing data with the EIA utility-level data, summing the population and housing measures for all counties that the utility serves.<sup>23</sup>

## 4.3 Sample Construction and Summary Statistics

After merging the data sets described above, we take a few additional steps to prepare the data for our empirical analyses that we detail in Appendix B. One important sample selection rule that we apply is omitting utilities that do not operate in the distribution segment of

---

<sup>23</sup>Some counties are served by multiple utilities, so there is some double-counting of population and housing, but such measures are not available at the utility level. This should not bias our estimates, though.

electricity delivery. Also, for utilities with AMI, we keep only those that initially started to deploy AMI between 2010 and 2016 (while keeping all utilities that never deploy and while keeping observations from 2007 through 2017). This allows us to include at least three years of pre-treatment data and one year of post-treatment data for all utilities that deploy AMI through our sample period. We also omit observations for which our key variables appear to be data entry errors (such as negative values for losses, sales, and customer counts).

Our final utility-level data set includes 14,241 observations across 1,303 utilities in the U.S. between 2007 and 2017.<sup>24</sup> Table 1 provides summary statistics. Column 1 provides the means and standard deviations of our main variables of interest for the full estimation sample. The average percentage of sales lost is about 5.7% and utilities serve about 57,000 customers on average. We also provide summary statistics separately for adopters in pre-treatment years (Column 2) and non-adopters (across all years) (Column 3) to explore whether they exhibit different characteristics. Those that eventually adopt AMI have slightly lower losses per sale in pre-treatment years relative to non-adopters but are much larger on average, as can be seen from how total sales and the number of customers served. We describe how we address this in our empirical approach in Section 5.

Appendix Figure D1 illustrates utilities’ deployment of AMI over time—a key source of variation that we use in our research design. In Panel A, we plot the cumulative proportion of utilities in our sample with any AMI deployed. In Panel B, we limit the sample to utilities that started to deploy AMI between 2010 and 2016 to show the distribution of utilities by initial deployment year for treated utilities in our estimation sample. We also plot the average of utilities’ AMI meters over the number of customers (i.e., the average proportion of utilities’ customers with AMI) by number of years since initial deployment (Panel C), which suggests that, customer adoption is relatively quick once deployment begins, with more than 50% of utilities’ customers having AMI after one year (on average).

---

<sup>24</sup>Because of the instrumental variable approach that we take, we actually gather data for the year 2018 as well, but 2018 is omitted when running the regressions because of using the lead policy variable as an excluded instrument (see Section 5).

## 4.4 Additional Data

### 4.4.1 Regional Occupation Employment

When exploring mechanisms through which AMI affects utility performance, we examine worker composition. We assemble data on local occupation employment for each Metropolitan (MSA) and non-metropolitan (non-MSA) area from the Occupational Employment and Wage Statistics (OEWS) provided by the U.S. Bureau of Labor Statistics (BLS). We extract the area-level employment information for the 2007-2018 period. Although these data do not differentiate occupations from industries, all meter readers are associated with the utility sector, whereas other occupations could be in various sectors.<sup>25</sup> As a result, occupations such as meter readers may be associated with non-electric utilities (e.g., gas or water) as well.

### 4.4.2 Electricity Reliability in Texas

To explore whether utilities use smart meters to improve electricity reliability, we examine the impact of AMI deployment on power outage duration and frequency for the state of Texas.<sup>26</sup> We manually transcribed and compiled outage data at the feeder line level—the power lines that carry electricity from substations to local or regional service areas—from the Public Utility Commission of Texas. Reliability is measured by two standard indices: System Average Interruption Duration Index (SAIDI) (the average duration of outages within a year) and System Average Interruption Frequency Index (SAIFI) (the average number of outages per year). This feeder line-level data set covers 7,294 feeder lines across 10 utilities operating in Texas between 2007 to 2016.

---

<sup>25</sup>We verified this with state-industry level employment data. We collected data on employment estimates by state and industry from the U.S. BLS derived from sample surveys, which provides annual industry-specific estimates on the number of employment for each occupation category in each state after 2012. Using this data, we confirm that the occupation category associated with meter readers (i.e., 43-5041) only appears within utility industry (i.e., the corresponding two-digit NAICS code is 22).

<sup>26</sup>We study Texas because the U.S. outage data do not start until 2013 and, by that time, many utilities had already started to deploy AMI. In contrast, the Texas within-utility data starts in 2007.

## 5 Empirical Strategy and Identification

### 5.1 Research Design

Our primary goal is to identify the causal impact of smart meter deployment on utility performance with a focus on the electricity loss rate. Estimating the effects using OLS may be plagued by various sources of endogeneity. Utilities that choose to invest in AMI may differ systematically from those that do not—they may already be better-managed or more innovative, or alternatively, they may be experiencing a systematically more significant decline in performance that motivates them to invest in AMI. The likelihood of deployment also may be correlated with local economic growth or other market characteristics that simultaneously impact electricity losses.

To address these concerns, we exploit quasi-experimental variation in utilities’ AMI smart meter deployments and augment a staggered difference-in-differences model with a two-stage least squares (2SLS) approach that directly addresses a key source of endogeneity. To summarize, our enhancement is in the spirit of the methodology developed by [Freyaldenhoven et al. \(2019\)](#), who show how instrumenting a “proxy” variable that is correlated with a potential confounder—but not driven by the treatment—with the lead of the policy treatment can identify the causal effect of the treatment. The method provides estimates of the treatment effect net of the pre-trend effects.<sup>27</sup>

**Foundation of Model.** Before discussing the 2SLS empirical strategy that we use throughout our analyses, we start by describing the foundation of our model that we build upon—event studies and staggered difference-in-differences. Using the first year that a utility deploys AMI smart meters as the treatment year, we start with an event study model that compares before and after differences in outcomes relative to the initial deployment year as follows:

$$Y_{it} = \sum_{k \neq -1} \beta_k \mathbb{1}[t - \tau_i = k] + \alpha_i + \gamma_{st} + \delta \mathbf{X}'_{it} + \varepsilon_{it}. \quad (1)$$

where  $Y_{it}$  denotes the respective outcome measure of interest for utility  $i$  in year  $t$ . We

---

<sup>27</sup>See [Freyaldenhoven et al. \(2019\)](#) for details on identification and we provide evidence of the pre-trend removal in our results section.

are primarily interested in  $\beta_k$ , the coefficients on indicator variables representing the AMI deployment event years, whereby we use the first year when utility  $i$  deploys smart meters as the treatment year and  $k$  represents the gap between the current year  $t$  and initial deployment year  $\tau_i$ . We exclude the dummy for  $k = -1$  so that the pre- and post- treatment effects are relative to one year prior to the start of AMI deployment.

We include utility fixed effects ( $\alpha_i$ ) to control for time-invariant differences between utilities and state-year fixed effects ( $\gamma_{st}$ ) to account for state-specific time-varying factors, such as market and policy conditions. We also control for local observable time-varying characteristics in the matrix  $\mathbf{X}_{it}$  (new building construction and population in counties within the utility’s service region).<sup>28</sup> We cluster standard errors at the utility level.

To summarize the dynamic effects of AMI adoption, we estimate the average effect within a pooled staggered difference-in-differences framework as follows:

$$Y_{it} = \beta_1 \text{AMI}_{it} + \alpha_i + \gamma_{st} + \delta' \mathbf{X}_{it} + \varepsilon_{it}, \quad (2)$$

where  $Y_{it}$  denotes the outcome of interest for utility  $i$  in year  $t$ ,  $\text{AMI}_{it}$  is the main treatment indicator for smart meter adoption equal to one starting in the year the utility has deployed AMI and zero otherwise. We include the same set of fixed effects and controls as before and cluster standard errors at the utility level.

If we were to make no other adjustments, identifying the causal effects would rest upon three main assumptions: 1) utility-level outcomes would have evolved along parallel trends absent treatment, 2) the average treatment effects do not vary by treatment timing, and 3) there are no spillover effects on untreated utilities (i.e., the stable unit treatment value assumption (SUTVA) holds). We now discuss the ways that we address potential violations of these assumptions.

**2SLS Augmentation.**— The event study approach of Equation 1 allows us to explore the dynamic effects of smart meter deployment. We can examine whether there appear to be differences in outcomes for untreated and treated units in pre-treatment years (i.e.,

---

<sup>28</sup>We use the inverse hyperbolic sine of new building construction because it contains zeros and use the log of population.



whether there are pre-trends), which has been the common practice for indirectly investigating whether the parallel trends assumption holds. However, recent studies note that such tests may be insufficient, as they may fail to detect pre-trends simply due to low statistical power (Freyaldenhoven et al. 2019; Roth 2022; Roth, Sant’Anna, Bilinski and Poe 2022). In a study of electric utilities, the concern is that even after including utility fixed effects, state-year fixed effects, and controls for some market trends in our baseline regressions, unobserved confounds may still exist.

In our setting, the main concern is that we cannot directly control for all local time-varying market and regional characteristics that may simultaneously impact the decision to deploy smart meters and performance. To address this, we follow the approach developed by Freyaldenhoven et al. (2019), which allows for causal identification of the treatment by removing the potential effects of pre-trends using a 2SLS approach. One must find a “proxy” variable for the unobserved confounder, and instead of simply including the variable as a control, instrument for it using leads of the treatment variable. The key assumption is that the “proxy” is affected by the unobserved confounder (e.g., economic growth) but not driven by the treatment.<sup>29</sup>

The main task, therefore, is to find a variable that follows a pattern similar to that which we expect the unobserved confounder to exhibit but which is not driven by AMI deployment. We propose and use population as our proxy, as it is plausibly correlated with economic growth and the related endogeneity concerns, but importantly, it is highly unlikely that AMI deployment is a key driver of population growth.

To empirically explore whether population may be a suitable proxy, we estimate Equation 1 with (log) population as the dependent variable and plot the coefficients in Appendix Figure D2.<sup>30</sup> Indeed, population increases over our sample period for utilities that deploy AMI relative to non-AMI utilities, suggesting that population is a reasonable proxy. As long as AMI deployment is not driving population growth, instrumenting for population with the

---

<sup>29</sup>As detailed in Freyaldenhoven et al. (2019), the approach removes the pre-trend effect such that estimated effects are net of the confound (i.e., the remaining dynamics of the outcome represent the causal effect). Freyaldenhoven et al. (2019) show that this approach outperforms alternative methods commonly applied in the literature to address potential pre-trends.

<sup>30</sup>As discussed earlier, we observe population at the county level, so we take the sum of the population in counties that fall within the utility’s service territory.

treatment variable lead allows us to recover the causal effect of AMI.

## 5.2 Addressing Other Potential Identification Concerns

**Treatment Timing.** Staggered difference-in-differences models may produce biased estimates if treatment effects are heterogeneous across units and over time (Goodman-Bacon 2021; Callaway and Sant’Anna 2021; Sun and Abraham 2021).<sup>31</sup> For reasons similar to the potential endogeneity of AMI deployment timing, one may be concerned about such heterogeneity in our setting. Some utilities may be more innovative and thus adopt earlier, and more innovative utilities may more effectively improve quality of service by leveraging the technology’s data and communications capabilities. Local economic growth also may induce utilities to adopt at different times, and if those utilities have more resources, the treatment effects may vary. Our 2SLS strategy directly addresses these concerns, but to be sure they do not bias our results, we also implement some of the other newly developed approaches as robustness checks in Section 6.4.

**SUTVA.** As is the case for any difference-in-differences research design, one key assumption behind our approach is that there are no spillover effects on untreated units. In our setting, the assumption is that a utility’s deployment of smart meters does not affect other utilities’ outcomes. This could be violated if, say, smart meters reduce line losses for a treated utility and this benefits neighboring utilities that do not invest in AMI by reducing pressure on their system as well, as all distribution lines are ultimately connected to an interdependent grid and electricity flows across service territory boundaries. Spillovers are most likely to occur between utilities that share borders. Such spillovers should attenuate our results if anything, but nonetheless, we probe this by carrying out various robustness checks in Section 6.4.2.

---

<sup>31</sup>Estimates from models like the one depicted in Equation 2 are weighted averages of all possible  $2 \times 2$  difference-in-differences between treated and untreated groups at different points in time and, therefore, may be biased if effects are heterogeneous across units or over time and result in negative weights.

## 6 Main Results: Effects of AMI on Electricity Losses

This section presents both our main results from estimating the impacts of smart meter deployment on electricity losses as well as robustness checks probing the identification assumptions of our research design.

### 6.1 Dynamic Effects

To begin, we estimate the dynamic effects of utilities’ smart meter roll-outs on our primary measure of utility performance—the electricity loss rate—employing the 2SLS estimator that extracts pre-trends by instrumenting our “proxy” variable (population) with a one-year lead of the treatment variable as the excluded instrument. Doing so illustrates our main findings for performance improvement while also allowing us to investigate whether our 2SLS approach addresses the endogeneity concerns discussed in Section 5.

We plot the estimated coefficients  $\beta_k$  and their 95% confidence intervals in Figure 2, with the  $x$ -axis indicating the number of years relative to initial AMI deployment. Immediately following AMI deployment, the loss rate starts to decline. The decrease is small at first but continues to steadily drop over time, leveling off after about 3 years post-treatment. Increasing improvements over time are consistent with the benefits of technology adoption—particularly digital technologies with complex capabilities—needing time to materialize. Utilities may need to invest in complementary technologies and organizational capital, like new processes and acquiring workers with different skills, to fully reap the rewards, similar to other contexts (e.g., Brynjolfsson and Hitt 2000; Bresnahan et al. 2002; Brynjolfsson et al. 2021a; Bronsoler et al. 2022).<sup>32</sup> The benefits of AMI also may scale with deployment intensity. We explore the magnitude of the effects over time further in the next sub-section.

Furthermore, we estimate the effects separately for the bottom quartile of the pre-treatment loss rate distribution and those above the bottom quartile, since the potential to reduce losses likely differs depending on baseline rates.<sup>33</sup> The estimates are plotted in Appendix Figure D3. For utilities above the bottom quartile (i.e., those with higher loss

---

<sup>32</sup>Cutler (2011), among others, also makes this point when studying IT adoption in healthcare settings.

<sup>33</sup>For utilities that deploy AMI at some point throughout our sample period, the cutoff for the bottom quartile of pre-treatment loss rates is 3.8%.

rates), the results are very similar to our main findings (Panel A), and reassuringly, we find no change in the loss rate for those that were already performing well (i.e., those in the bottom quartile of the pre-treatment loss rate distribution (Panel B).

Finally, the dynamics illustrated in Figure 2 also provide confidence in our 2SLS research design when comparing them to results from a standard OLS estimation. When taking our 2SLS approach, the differences in the loss rate through pre-treatment years are much more stable than when using OLS, suggesting that instrumenting our proxy variable with the treatment lead successfully removes some influence of confounders. See Appendix Figure D4 for a comparison to the OLS results. The OLS estimates exhibit a very slight pre-trend in the loss rate (Panel A), but this appears to be extracted once making the 2SLS adjustment (Panel B). The pre-trend is more prominent when looking at *total* electricity losses (the numerator when calculating the loss rate) as opposed to just the loss rate. There is a pre-trend in (log) total losses prior to AMI deployment when estimating using OLS (Panel C), but this disappears once we implement our 2SLS approach (Panel D).

## 6.2 Average Effects

We now turn to estimating the average effect of AMI deployment over the post-treatment period following Equation 2 and implementing our 2SLS approach. We find that the loss rate decreases by 0.002 percentage points on average (Column 1 of Table 2), representing a 3.8% reduction relative to AMI adopters' pre-treatment mean loss rate. These estimates likely understate the potential utility performance improvements, though, as the sample includes utilities that already achieve a low level of line losses and thus have very little room to improve. When omitting utilities in the bottom quartile of the pre-treatment loss rate distribution, we find that the loss rate declines by 0.003 percentage points on average, reflecting a 5% improvement relative to the pre-treatment mean (Column 2 of Table 2). On the contrary, loss rates do not change for utilities that were already performing well, as expected (see Column 1 of Appendix Table C1).

Intuitively, the dynamic effects plotted in Figure 2 also indicate that efficiency improvements increase over time. Benefits may scale with intensity of treatment (i.e., the proportion of customers with smart meters), for example, and roll-outs may occur over a couple of years.

It also can take time for utilities to develop or acquire the skills to fully leverage smart meter capabilities, or for them to invest in complementary AMI features (like data management systems) that are important for realizing the benefits of digitalization.

To account for this, we omit the year of initial deployment and the two years that follow such that we capture the efficiency improvements achieved three years post-deployment and thereafter.<sup>34</sup> When doing so, we find that the loss rate declines by 0.003 percentage points, reflecting 5.8% efficiency gain relative to the pre-treatment mean loss rate for utilities that deploy AMI (see Column 3 of Table 2). When omitting utilities in the bottom quartile of the pre-treatment loss rate distribution, this increases to a 0.004 percentage point decline, which translates into a 6.7% efficiency gain relative to the pre-treatment mean of AMI utilities in the sample. Once again, we find no change in loss rates for utilities that were already performing well when omitting the deployment year and two years thereafter (see Column 2 of Appendix Table C1).

Lastly, to demonstrate the importance of implementing the 2SLS approach, we compare these results to what we would have found had we used OLS (see Appendix Table C2). When doing so, the estimates can be interpreted as “unadjusted”—they include both the true causal effect as well as the confounder effects. We generally still find negative and statistically significant effects on the loss rate when doing so but the magnitudes are smaller. When using the full sample using OLS, we find a 1.9% decline relative to the sample mean compared to the 3.8% effect we find when implementing the 2SLS approach (Column 1 of Appendix Table C2).

### 6.3 Continuous Treatment

Given how the benefits of AMI may depend on the proportion of customers that have adopted—having more AMI meters deployed displaces a greater number of old meters that may be providing faulty readings, and more generally, it provides utilities with more information—we also estimate a version of the model with a continuous treatment variable. We replace our main binary treatment variable with an “intensity of treatment” variable

---

<sup>34</sup>All years of data are still included for utilities that never adopt AMI.

measured as the proportion of a utility’s customers that have AMI.<sup>35</sup>

The results are very similar but a bit stronger relative to when using the binary treatment (see Panel B of Table 2). In Column 1, we find that the loss rate declines by 5.8% when using the continuous treatment variable in comparison to a 3.8% decline when using the binary treatment. These results are consistent with the benefits of AMI being more substantial as a greater proportion of customers adopt AMI, as the coefficients when using the continuous treatment can be interpreted as the change in the loss rate when going from no deployment to 100% adoption. Once we omit initially high performers (Columns 2 and 4) and include only later years after 3 years of AMI deployment (Columns 3 and 4), we find that the results when using the continuous and binary treatments converge.<sup>36</sup> This is likely because, on average, AMI roll-outs occur relatively quickly once they begin. As seen in Panel C of Appendix Figure D1, about 50% of customers adopt AMI (on average) within the first year that a utility deploys AMI, increasing to about 70% after 3 years.

## 6.4 Additional Identification and Robustness Checks

Recent research points to several reasons to be cautious when using OLS to estimate staggered difference-in-difference models. The 2SLS approach that we apply throughout the paper addressing endogeneity associated with smart meter deployment and adoption aims to directly tackle some of those concerns. For example, one main strand of the literature argues that standard tests for the parallel trends assumption (i.e., examining differences in pre-treatment years) may not detect statistically significant differences simply because of low statistical power (Roth 2022). Our approach addresses this by extracting potential effects of pre-trends in the spirit of the method developed in Freyaldenhoven et al. (2019). In this sub-section, we address two other potential concerns: treatment effect heterogeneity across time periods and spillovers to untreated units.

---

<sup>35</sup>More specifically, this is measured as the utilities’ number of AMI meters over number of customers.

<sup>36</sup>Estimates from when using OLS can be found in Panel B of Appendix Table C2.

### 6.4.1 Adoption Timing

In the multi-period staggered treatment context, coefficients from standard TWFE models are convex weighted averages that include early-treated units as part of the control group for later-treated units, and if treatment effects differ based on treatment timing, such estimates do not identify an average treatment effect (e.g., see [Borusyak, Jaravel and Spiess \(2021\)](#), [de Chaisemartin and D’Haultfoeuille \(2020\)](#), [Goodman-Bacon \(2021\)](#), [Callaway and Sant’Anna \(2021\)](#), [Sun and Abraham \(2021\)](#)).

To deal with this, we implement [Callaway and Sant’Anna \(2021\)](#)’s “doubly robust” DiD method using stabilized inverse probability weighting. The approach allows group-time average treatment effects on the treated to be nonparametrically point-identified and aggregated, whereby a “group” is defined based on the time period when units (i.e., utilities) are first treated. The results are presented in Appendix Table [C3](#). We first only include never-treated units in the control group (Columns 1-2) and then also include not-yet-treated units (Columns 3-4). The point estimates are identical to our main findings in both cases, remaining statistically significant at the 5% level when including all utilities in the sample and becoming statistically stronger (to the 1% level) when omitting initially “high-performers.”

### 6.4.2 SUTVA

Another key assumption underlying all difference-in-differences research designs is that there are no spillover effects on untreated utilities (i.e., the stable unit treatment value assumption (SUTVA) holds). This might be a concern because utilities’ distribution lines are ultimately all connected to the same grid. In our context, spillovers would likely attenuate the estimates if anything, since declining losses in one region might also improve system performance (i.e., reduce losses) in neighboring regions.

Nonetheless, we explore the possibility of SUTVA violations in two ways. First, we control for whether a neighboring utility deployed smart meters and find that the results do not change (see Column 1 of Appendix Table [C4](#)).<sup>37</sup> Second, we estimate the effects of AMI on the amount of power received/imported from other utilities and exported/delivered to

---

<sup>37</sup>Since we do not observe the exact utility border locations in our data, we define utilities as neighbors if they serve customers in the same county.



other utilities. If the adoption of AMI in one utility’s service area negatively affects the grid in others’ service areas, we might expect changes in exported and imported power. We find no statistically significant effects on either (see Columns 2 and 3 of Appendix Table C4).

## 7 Mechanisms

We now shift to developing a better understanding of the channels through which utility performance improves. We provide four sets of results that are consistent with utilities using AMI to enhance different aspects of energy management, which in turn, can boost system performance and service quality: improving consumption measurement and billing accuracy; introducing new products, like dynamic pricing and demand response programs; investing in complementary human and organizational capital, such as workers with “quant” skills; and responding to power outages faster.

### 7.1 Improving Consumption Measurement and Billing Accuracy

One of the ways in which AMI can reduce losses and enhance performance is through improved consumption measurement and billing accuracy. With analog technology, meter readings and data entry are subject to human error. Digital meters are also more accurate. Electromechanical meters degrade and slow down as they age, leading to electricity usage readings that are lower than actual consumption (EPRI 2008). Replacing many old meters could, therefore, lead to a substantial increase in sales. Although this means higher electricity bills—a common customer complaint—customers also may value more accurate billing. Utilities’ also can invest recovered revenue to further improve infrastructure. Moreover, having a more accurate picture of the system can help utilities reduce technical losses as described in Section 3.4. Lastly, smart meters can also increase sales by enhancing utilities’ ability to identify electricity theft (e.g., meter tampering or illegal connections), which is a significant source of NTLs in the U.S. (EPRI 2008; U.S. Department of Energy 2016a).

With these factors in mind, we explore whether AMI appears to reduce losses through improved billing accuracy by examining electricity sales. Figure 3 illustrates that (logged) sales per customer indeed start to increase immediately following AMI deployment, and the

magnitude of the change continues to grow for about three years. The immediacy of the effect is consistent with new meters increasing the accuracy of consumption measurement and billing, including reducing electricity theft. The continued increase for a few years is consistent with the utility requiring time to achieve full deployment.

## 7.2 Introducing New Products

Smart meters allow utilities to introduce or improve dynamic pricing and other demand response programs, which can incentivize customers to shift demand away from peak periods when the grid is constrained.<sup>38</sup> As described in Section 3, even small reductions in demand during these peak times can reduce technical losses. Offering such programs also can improve customer satisfaction if they have flexibility in the timing of their consumption and value the opportunity to lower their electricity bills.

To investigate whether such products play a role in improving performance, we first examine whether the likelihood that utilities offer them increases following AMI deployment. We construct indicator variables equal to one when the number of customers using dynamic pricing or demand response programs first becomes positive and zero otherwise as our dependent variables. The results are presented in Columns 1 and 2 of Table 3. On average, the likelihood of introducing these services indeed increases by 3.9% and 3.2% for dynamic pricing and demand response programs, respectively.

Next, we explore whether consumers appear to have changed their electricity use behavior with the introduction of such products, and if so, whether this contributes to the decline in losses. We do not observe the timing of consumption to test this directly, unfortunately. However, we examine whether the introduction of these products impacts total sales per customer to test whether there are any changes in gross consumption. We interact the AMI treatment with our indicator variables for whether the utility has started to offer dynamic pricing or demand response programs and estimate the interaction effects on sales per customer (Columns 3-4 of Table 3). We then do the same with loss rates as the dependent variable to see whether the introduction of these programs enhances the effect of AMI on

---

<sup>38</sup>Some forms of such programs could be implemented without smart meters, such as seasonal pricing, but more granular real-time information on electricity usage allows for intra-day load smoothing.

losses (Columns 5-6 of Table 3).<sup>39</sup>

There are two key takeaways. First, both products offset the increases in sales per customer that emerge following AMI deployment, suggesting some degree of consumer responsiveness. However, these offsets do not seem to account for the loss rate improvements, suggesting that other factors drive loss reductions in our setting. This is not to say that dynamic pricing and demand response programs—and the demand smoothing that can be achieved either on the consumer or utility side—could never contribute to performance improvements, though. Consumers’ uptake of these products was still quite low during our study period, so a more meaningful effect could potentially be achieved with broader use and could be explored in future work.

### 7.3 Investing in Complementary Organizational Capital

If utilities use the AMI to directly transmit consumption data to their billing systems, then we should observe a decrease in the number of meter readers employed by utilities. Furthermore, fully realizing the benefits of AMI likely requires additional investments in complementary organizational innovation and human capital, similar to the case of when firms adopt information and communication technologies.<sup>40</sup> Integrating AMI technology into existing processes and practices, and analyzing the data that it generates to improve performance, requires advanced data analysis and software skills.

We do not observe the number or type of workers at the utility level to test this directly. To explore workforce composition as a proxy for organizational change, though, we gather annual metropolitan service area (MSA) by occupation data to examine whether there is a reduction in local employment of utility meter readers and/or an increase in data and software engineering-oriented workers.<sup>41</sup>

We first provide graphical evidence on the relationship between the composition of

---

<sup>39</sup>Results from estimating each of these with OLS for comparison are provided in Appendix Table C5.

<sup>40</sup>The broader literature studying information technology adoption finds that successful implementation and realization of the benefits requires complementary investments, and notably, organizational innovation (Brynjolfsson and Hitt 2000; Caroli and Van Reenen 2001; Bresnahan et al. 2002; Brynjolfsson et al. 2021a).

<sup>41</sup>The MSA-level data does not specify industry, but as the meter reader occupation category covers only the utilities sector (electricity, gas, and water), we can be fairly confident that changes in this occupation category are strongly correlated with changes in electricity utilities specifically.

workers in the local labor market and AMI adoption. In each panel of Figure 5, the horizontal axes represent the proportion of customers that are AMI within an MSA. The vertical axes are the residuals of the logarithm of employment after absorbing the MSA fixed effects, population, and building units. We classify the occupations into three categories—meter readers, quantitative and computation jobs, and others—and show the binned-scatter plot for each of the category. Panels A and B of Figure 5 provide compelling evidence that AMI deployment is associated with a decline in meter readers and an increase in quantitative and computation jobs. In contrast, there is no clear pattern between AMI adoption and other jobs (Panel C), which is reassuring.

To quantify the effects, we estimate the following triple-difference model:

$$Y_{ijt} = \beta \text{AMI}_{it} \times \text{RelatedOCC}_j + \alpha_{ij} + \delta_{it} + \varepsilon_{ijt}. \quad (3)$$

The outcome variable is the logarithm of the number of employment in MSA  $i$  for occupation  $j$  in year  $t$ .  $\text{AMI}_{it}$  is a binary indicator for whether any utility operating in MSA  $i$  has deployed AMI in year  $t$ .  $\text{RelatedOCC}_j$  is a binary indicator for AMI-related occupation, which is defined as either meter readers (denoted by “Billing”) or quantitative and computation jobs (denoted by “Quant”). We control for macroeconomic shocks, such as population growth and regional economic policies, which may affect the number of workers differently across locations with MSA-year fixed effects and for time-invariant differences in the labor force across MSAs with MSA-occupation fixed effects. The coefficient of interest,  $\beta$ , captures how the number of employment for meter readers or quantitative and computation jobs within an MSA area is changing relative to other unrelated occupations.

Table 4 presents the estimation results. In Column 1, we find that the number of meter readers decreases by 18.6% relative to other occupations. We also drop observations associated with quantitative and computation jobs in Column 2, because if there is a simultaneous increase in these types of workers due to AMI adoption, they would make a poor control group. We still find an 18.2% decrease in meter readers. We carry out the same exercise to estimate the effect for quantitative and computation jobs, and indeed find that they increase by 7.4% relative to other occupations, as shown in Column 3. When omitting meter readers

from this estimation to address potential SUTVA violations, we again find a 6.8% increase in quantitative and computation jobs.

We also limit the sample to include only MSAs that either deployed AMI between the years 2008 and 2016 or do not deploy at all.<sup>42</sup> Panel A of Table C6 reports the estimates, which are similar to those in Table 4. In Panel B, we further exclude the MSAs that already deployed smart meters by 2008 and the estimated effects are similar. For quantitative and computation jobs, the coefficient estimates are smaller and become less statistically significant, but this is likely due to sample size limitations.

Taken together, these findings suggest that, on average, utilities invest in organizational innovation with the adoption of smart meters. This is consistent with management innovation being an underlying driver of the service provision improvements.

## 7.4 Responding to Power Outages Faster

Finally, we explore whether utilities may use smart meters to improve reliability (i.e., power outage duration and frequency). As discussed in Section 3.4, smart meters are often equipped with last gasp alarms that automatically notify utilities when outages occur. Utilities must actually respond accordingly, though, to restore power and for outage duration to decline. We interpret such behavior as an improvement in energy management. Furthermore, utilities also may be able to avoid some outages, such as those caused by equipment failure, if they use AMI to identify bottlenecks and investment needs.

Using our feeder-line level for utilities in Texas, we estimate the effects of AMI deployment on reliability with the following model:

$$Y_{ijt} = \exp(\beta_1 \text{AMI}_{jt} + \alpha_i + \gamma_t + \delta' \mathbf{X}_{jt}) + \varepsilon_{ijt}, \quad (4)$$

where  $Y_{ijt}$  denotes the reliability outcome for feeder line  $i$  of utility  $j$  in year  $t$  and the indicator  $\text{AMI}_{jt}$  is utility-level AMI deployment treatment variable defined as before. We include feeder line-level fixed effects ( $\alpha_i$ ) to control for time-invariant line-specific factors that

---

<sup>42</sup>In our utility-level analysis, we limit the sample of utilities with AMI to those that deployed between 2010 and 2016, but we do not impose such a restriction here because most (291 out of 434) MSAs have at least one utility with AMI by then, so we would lose more than 80% of the sample.

may impact reliability as well as year fixed effects ( $\gamma_t$ ) to account for changing conditions over time that are common across all feeder lines in Texas. The matrix  $\mathbf{X}_{jt}$  includes the same controls as in our primary analyses as well as utility-year linear trends in some cases, as having within-utility variation allows us to control for how utilities and their customers may be changing differently over time. Due to the presence of zero values in the reliability outcome, we estimate the model using Poisson quasi-maximum likelihood following [Chen and Roth \(2024\)](#). To accommodate the 2SLS framework in this nonlinear setting, we implement a control function approach.<sup>43</sup>

The results are presented in Table 5. Outage duration (i.e., the number of minutes of sustained interruptions experienced by a utility’s average customer) decreases by 6.8-7.8% following AMI deployment (Columns 1 and 2)<sup>44</sup>. On the other hand, we find no effect on outage frequency. This suggests that further action beyond improved monitoring and identifying weak points may be important for avoiding outages, such as making additional investments in the grid. Future work could explore this by examining whether investments made post-AMI deployment help reduce outage frequency.

## 8 Implications of Utility Ownership

Our findings suggest that investing in AMI can provide efficiency and quality of service benefits, and that energy management plays an important role. This raises the question of what determines whether utilities have the incentives and capabilities to make longer-run management and organizational investments to realize those benefits in the first place.

One potential factor could be utility ownership structure given the differences in incentives and constraints. In the U.S., electric utilities can be government-owned (i.e., operated by municipalities, the state, or the federal government), investor-owned (IOUs), or cooperatives (i.e., non-profits operated by their members). While all utilities face budgets, regulations, and requirements to provide customers with reliable service, each ownership

---

<sup>43</sup>Specifically, we first estimate a first-stage regression of  $\log(\text{population})$  on the lead of AMI treatment variable and other controls to obtain the residuals. These residuals are then included as an additional control variable in the Poisson regression model to account for endogeneity. Standard errors are computed using bootstrap procedures with clustering at the feeder line level.

<sup>44</sup>The percentage change is calculated by  $\exp(\beta_1) - 1$ .

structure generates different incentives that could impact investment behavior and innovative activities. Some of these differences mirror those documented for publicly-owned versus privately-owned organizations in other sectors, such as healthcare.<sup>45</sup>

For example, profit-maximization objectives may incentivize IOUs to invest in technologies that provide cost reductions, like AMI. However, given the pressure IOUs face from shareholders to quickly generate returns on investment, they may be more focused on the near-term cost reductions achieved just through replacing old analog meters (e.g., no need for manual meter readings) as opposed to the more comprehensive organizational changes required for achieving longer-term benefits, like reducing loss rates. On the other hand, government-owned utilities (and cooperatives) may tolerate longer time horizons, which may be required for investing in the complementary technologies and organizational capital required for fully realizing the benefits of digitalization. They also may prioritize social objectives—like quality of service—especially in the context of government-owned utilities run by elected officials, given how their customers are their constituents.

## 8.1 Heterogeneity in Effects by Utility Ownership

We estimate the effects of smart meter deployment on loss rates by utility ownership and find that the efficiency gains are primarily driven by government-owned utilities, and to a lesser extent, cooperatives (see Figure 4).<sup>46</sup> Loss rates decline substantially and quickly for government-owned utilities following AMI deployment (Panel A), and they also decline for cooperatives but the change is less pronounced (Panel B). In contrast, loss rates are flat for IOUs following AMI deployment (Panel C), although AMI appears to at least negate an otherwise upward sloping pre-trend.

While we cannot draw strong conclusions about the specific characteristics of different ownership structures that may be driving this heterogeneity, the findings are consistent with how government-owned utilities (and to a lesser extent, cooperatives) may have more of an incentive to prioritize social benefits and the longer-run adjustments associated with AMI

<sup>45</sup>See Shleifer (1998) and Hart et al. (1997) for seminal examples.

<sup>46</sup>We include all utilities without AMI in the control group (despite ownership type) while the treatment group in each case includes only utilities with each ownership type that have deployed AMI.



that can contribute to higher quality of service relative to IOUs.

## 8.2 Ruling Out Alternative Explanations

We probe these results in a few ways to ensure that they are not driven by other observable differences across utilities that may differ systematically by ownership type. First, if government-owned utilities have higher loss rates prior to AMI deployment relative to other utilities, pre-treatment performance may be at play. We find that this is not the case, though. If anything, the average pre-treatment loss rate for treated utilities was lower for government-owned utilities (0.045) relative to IOUs (0.051) and cooperatives (0.058) for those in our sample (see Appendix Table C7).

Second, we explore whether utility size explains the heterogeneity, since IOUs are much larger than government-owned utilities and cooperatives, on average, and the benefits of AMI may scale with technology diffusion. It may take longer to fully deploy smart meters for large utilities and thus it may take longer for IOUs to fully realize the benefits.<sup>47</sup> We estimate the effects for sub-samples of utilities that are more comparable in terms of size by omitting IOUs that are larger than the largest non-IOU in our sample according to number of customers. However, we still find that loss rates remain flat following AMI for these “smaller” IOUs (see Appendix Figure D5).

Third, since IOUs do take longer to reach high diffusion rates relative to government-owned utilities and cooperatives (see Appendix Figure D6), we also estimate the heterogeneous effects using our continuous treatment variable (measured as the number of AMI smart meters over number of customers, as done in Panel B of Table 2). The results are presented in Appendix Table C8. We still find no effect of AMI on loss rates for IOUs even once reaching full adoption of AMI, whereas loss rates decline by 11.1% for government-owned utilities and 3.4% for cooperatives.

Lastly, we explore whether electricity market deregulation explains the heterogeneity across utility ownership. An extensive literature studies the benefits associated with electricity market deregulation. Although all ownership types can exist in both regulated and

---

<sup>47</sup>The average number of customers for IOUs is 599,187 compared to 17,885 for government-owned utilities and 23,874 for cooperatives.

deregulated markets, it could be that deregulation plays a role if one ownership type is more heavily concentrated in deregulated or regulated states. We cannot formally test the impact of deregulation in our setting since most changes occurred in the 1990s, however we probe this by splitting the ownership sub-samples further based on whether the utility is located in a state with or without any electricity market deregulation.<sup>48</sup> If loss rates only decline for government-owned utilities in deregulated markets—or if loss rates decline for all three ownership types in either regulated or deregulated states—perhaps regulation vs. deregulation is an underlying driver.

We find that this is not the case (see Appendix Figure D7). Loss rates are flat for utilities in deregulated states for all ownership types (Panels B, D, and F), whereas they decline for government-owned utilities in states with regulated electricity markets (and for cooperatives to a lesser extent) (Panels A and C). Notably, we still find no decline in loss rates for IOUs in regulated states (Panel E). This preserved heterogeneity across ownership within regulated states suggests that ownership plays a role, and we remain cautious in drawing strong conclusions about deregulation based on this heterogeneity analysis.

## 9 Financial Performance, Pricing, and Payback Period

### 9.1 Revenue and Pricing

Reductions in losses can bolster utilities’ financial performance in various ways. Although we cannot examine all potential benefits with our data—for example, we do not have information on operational and labor costs that may decline if utilities shift away from manual meter readings—we can examine the implications of AMI for revenue and pricing. Reductions in losses imply enhanced revenue recovery, so we expect to see an increase in total revenue, all else equal. The effects on pricing could go in either direction, as utilities may pass through the benefits to consumers in the form of lower prices, or they may increase prices to recover costs associated with AMI investments.

Table 6 provides the estimated effects on total revenue (Columns 1-2) and average prices

---

<sup>48</sup>Lists of states included in each sub-set can be provided upon request.

(Columns 3-4), which we construct as total revenue divided by total sales. When estimating the effects for the full sample, we find that total revenue increases by about 0.9% in the post-deployment period on average (Column 1, Panel A) and by about 1.7% after three years (Column 1, Panel B). Relative to the pre-treatment mean total revenue for utilities that deploy AMI (\$139.3 million), these translate into revenue increases of \$1.25 million per year on average and \$2.37 million per year after three years. Once omitting utilities that were already high performers before deploying AMI, we find that revenue increases by 1.4% on average (Column 2, Panel A) and 2.2% after three years (Column 2, Panel B). Relative to the pre-treatment mean revenue for these utilities (\$141.6 million), these figures translate into revenue gains of \$1.98 million on average and \$3.12 million after three years.

If utilities pass-through the benefits of AMI to consumers, we would expect to find a decrease in average prices. On the other hand, they might pass-through the investment costs by increasing prices. We estimate the effects on average prices to better understand the financial implications for consumers and find no effect, on average (Columns 3 and 4). However, given the differences in loss rate reductions across ownership type that we found in Section 8, these results may mask important heterogeneity. Moreover, it may take time for utilities to reduce prices due to rate of return regulation.

With this in mind, we explore the dynamic effects on average prices by ownership type in Appendix Figure D8. Indeed, average prices decline following AMI deployment for government-owned utilities (Panel A). The reduction is small at first but becomes much more pronounced after about 3-5 years. For cooperatives, average prices remain flat until about 5 years post-AMI, when they then start to decline (Panel B). On the other hand, for IOUs, average prices do not decline at all following AMI deployment (Panel C), although the otherwise upward sloping pre-trend in average prices appears to flatten.

## 9.2 Back-of-the-Envelope Payback Period

To put these revenue estimates into context relative to the cost of smart meter investments, we conduct a simple cost-benefit analysis to calculate the payback period of AMI deployment. Table C9 summarizes the key components of this analysis. Panel A presents the estimated annual revenue gains from AMI adoption, as discussed earlier. Panel B reports the cost

calculation. We assume a total installation cost of \$200 per smart meter, inclusive of both hardware and labor. This figure is based on [Greenough \(2015\)](#)’ estimates in 2015 and include both hardware and labor. We view \$200 as a conservative figure relative to the costs utilities are likely to face today, given continued declines in hardware prices.<sup>49</sup> Utilities adopting AMI had 62,273 customers on average in pre-treatment years in the full sample and 66,515 when omitting initially high performers. Full deployment for the average utility would therefore cost approximately \$12.45 million and \$13.30 million, respectively.

Assuming all smart meters are installed upfront and that the revenue gains accrue as fixed annual cash flows received at the end of each year, the resulting payback periods range from 5 to 18 years depending on the discount rate and the revenue gain estimate (Panel C). Once considering the revenue gain estimate from when omitting the first two years post-deployment, the resulting payback periods range from 5 to 7 years.

While this payback period analysis provides a useful benchmark for assessing the financial viability of AMI deployment based on observable revenue gains, it captures only a subset of the potential benefits. Other important advantages—such as operational savings, improved outage response, and environmental gains through enhanced demand management—remain unmeasured in our data. These omitted benefits can be substantial. For example, the U.S. Department of Energy estimates that AMI deployment led to \$316 million in labor and related cost savings across 19 utilities over a three-year period ([U.S. Department of Energy 2016b](#)). Future work leveraging more granular utility operations data could offer a more comprehensive welfare evaluation of AMI investments.

## 10 Conclusion

Digitalization is often found to enhance various aspects of firm performance, such as reducing costs and enhancing productivity. However, whether this applies to the public services context has been unclear to date. Results from existing work studying private sector firms may

---

<sup>49</sup>Cost estimates in 2015 were \$200 ([Greenough 2015](#)), and hardware costs have declined since then. However, recent increases in labor costs may offset some of these reductions. This \$200 per-meter cost falls within the range of \$130 to \$600 reported by the U.S. Department of Energy for deployments during the 2009–2015 period ([U.S. Department of Energy 2016b](#)).

not transfer given how organizations providing public services often operate under different market conditions and face different incentives and constraints. Studying digitalization in the public services context can be difficult due to relatively low uptake in many industries, though, and understanding how to improve public services more generally can be difficult due to challenges with measuring quality of service.

We overcome these challenges by examining the impact of digitalization on utility performance and quality of service in the U.S. electricity sector, which provides a unique setting in which adoption of digital technologies is now widespread and objective performance and service quality measures are reported consistently. We found that, on average, the electricity loss rate decreased by 3.8%. The effects are much larger for utilities with high pre-treatment losses and once at least three years have passed since initial deployment. Findings from additional analyses suggest that various aspects of energy management—such as improved billing accuracy and enhanced system monitoring—are likely at play.

The impacts of AMI on electricity reliability are mixed but consistent with anecdotes from utilities when reporting on the benefits incurred from AMI during the time period that we study. Power outage duration decreased, signalling that utilities use the information from AMI to identify and respond to interruptions more quickly. The frequency of outages does not change, though.

The findings in this paper are important and timely for policy. Electricity infrastructure in the U.S. and many other countries is aging, making the grid increasing susceptible to disruption. At the same time, extreme weather events are occurring with increasing frequency due to climate change and utilities are facing new energy management challenges with the integration of intermittent renewable electricity as well as expected load growth that is on the horizon. Governments globally are allocating large amounts of public expenditures to modernizing infrastructure in hopes of adapting and preparing for this transition, but research on whether these investments deliver on their promise is scant. Taken together, our findings suggest that digitalization can be a tool for improving electricity service quality and utility performance, but the magnitude of the benefits may hinge upon investing in complementary organizational capital.

## References

- Allcott, Hunt, Allan Collard-Wexler, and Stephen D. O’Connell, “How Do Electricity Shortages Affect Industry? Evidence from India,” *American Economic Review*, 2016, 106 (3), 587–624.
- ASCE, “A Comprehensive Assessment of America’s Infrastructure: 2021 Report Card for America’s Infrastructure,” *American Society of Civil Engineers*, 2021.
- Bar-Gill, S., E. Brynjolfsson, and N. Hak, “Helping Small Businesses Become More Data-Driven: A Field Experiment on eBay,” *Management Science*, 2024.
- Bartel, Ann, Casey Ichniowski, and Kathryn Shaw, “How Does Information Technology Affect Productivity? Plant-Level Comparisons of Product Innovation, Process Improvement, and Worker Skills,” *The Quarterly Journal of Economics*, 2007, 122 (4), 1721–1758.
- BC Hydro, “BC Hydro Power Smart Fact Sheet,” 2016. [https://www.bchydro.com/news/press\\_centre/news\\_releases/2016/smi-fact-sheet.html](https://www.bchydro.com/news/press_centre/news_releases/2016/smi-fact-sheet.html).
- Bergman, M.A., P. Johansson, S. Lundberg, and G. Spagnolo, “Privatization and Quality: Evidence from Elderly Care in Sweden,” *Journal of Health Economics*, 2016, 49, 109–119.
- Berkouwer, S., P. Biscaye, M. Mikdash, S. Puller, and C. Wolfram, “Voltage Quality and Economic Activity,” *Working Paper*, 2024.
- Blonz, J., K. Palmer, C. Wichman, and D. Wietelman, “Smart Thermostats, Automation, and Time-Varying Prices,” *American Economic Journal: Applied Economics*, forthcoming.
- Bloom, N., R. Sadun, and J. Van Reenen, “Americans Do IT Better: US Multinationals and the Productivity Miracle,” *American Economic Review*, 2012, 102 (1), 167–201.
- Bloom, Nicholas and John Van Reenen, “Measuring and Explaining Management Practices across Firms and Countries,” *The Quarterly Journal of Economics*, 2007, 122 (4), 1351–1408.
- , Carol Propper, Stephan Seiler, and John Van Reenen, “The Impact of Competition on Management Quality: Evidence from Public Hospitals,” *The Review of Economic Studies*, 2015, 0, 1–33.
- , Erik Brynjolfsson, Lucia Foster, Ron Jarmin, Megha Patnaik, Itay Saporta-Eksten, and John Van Reenen, “What Drives Differences in Management Practices?,” *American Economic Review*, 2019, 109 (5), 1648–1683.
- , Renata Lemos, Raffaella Sadun, and John Van Reenen, “Healthy Business? Managerial Education and Management in Health Care,” *The Review of Economics and Statistics*, 2020, 102 (3), 506–517.

- , – , **Raffaella Sadun**, and **John Van Reenen**, “Does Management Matter in Schools?,” *Economic Journal*, 2015, 125 (5), 647–674.
- Bollinger, B. and W. Hartman**, “Information vs. Automation and Implications for Dynamic Pricing,” *Management Science*, 2020, 66 (1), 1–501.
- Bollinger, Bryan, Kenneth Gillingham, Naim Darghouth, and Andres Gonzalez-Lira**, “Valuing Technology Complementarities: Rooftop Solar and Energy Storage,” *Working Paper*, 2023.
- Borenstein, S., J. Bushnell, and E. Mansur**, “The Economics of Electricity Reliability,” *Journal of Economic Perspectives*, 2023, 37 (4), 181–206.
- Borusyak, Kirill, Xavier Jaravel, and Jann Spiess**, “Revisiting Event Study Designs: Robust and Efficient Estimation,” *arXiv:2108.12419 [econ]*, 2021.
- Brandon, A., C. Clapp, J. List, R. Metcalfe, and M. Price**, “The Human Perils of Scaling Smart Technologies: Evidence from Field Experiments,” *Working Paper*, 2022.
- Bresnahan, T., E. Brynjolfsson, and L. Hitt**, “Information Technology, Workplace Organization, and the Demand for Skilled Labor: Firm-Level Evidence,” *The Quarterly Journal of Economics*, 2002, 117 (1), 339–376.
- Bronsoler, A., J. Doyle, and J. Van Reenen**, “The Impact of Health Information and Communication Technology on Clinical Quality, Productivity, and Workers,” *Annual Review of Economics*, 2022, 14, 23–46.
- Brown, David and Lucija Muehlenbachs**, “The Value of Electricity Reliability: Evidence from Battery Adoption,” *Working Paper*, 2023.
- Brynjolfsson, E. and A. Saunders**, *Wired for Innovation: How Information Technology is Reshaping the Economy*, MIT Press, 2013.
- and **K. McElheran**, “The Rapid Adoption of Data-Driven Decision-Making,” *American Economic Review*, 2016, 106 (5), 133–139.
- and **LM. Hitt**, “Beyond Computation: Information Technology, Organizational Transformation and Business Performance,” *Journal of Economic Perspectives*, 2000, 14 (4), 23–48.
- and **M. Hitt**, “Computing Productivity: Firm-Level Evidence,” *Review of Economics and Statistics*, 2003, 85 (4), 793–808.
- , **D. Rock**, and **C. Syverson**, “The Productivity J-Curve: How Intangibles Complement General Purpose Technologies,” *American Economic Journal: Macroeconomics*, 2021, 13 (1), 333–72.
- , **W. Jin**, and **K. McElheran**, “The Power of Prediction: Predictive Analytics, Workplace Complements, and Business Performance,” *Business Economics*, 2021, 56 (4), 217–239.

- Burkhardt, J., K. Gillingham, and P. Kopalle**, “Field Experimental Evidence on the Effect of Pricing on Residential Electricity Conservation,” *Management Science*, 2023, 69 (12), 7151–7882.
- Callaway, Brantly and Pedro HC Sant’Anna**, “Difference-in-differences with multiple time periods,” *Journal of econometrics*, 2021, 225 (2), 200–230.
- Caroli, E. and J. Van Reenen**, “Skill-Biased Organizational Change? Evidence from a Panel of British and French Establishments,” *The Quarterly Journal of Economics*, 2001, 116 (4), 1449–92.
- Carranza, Eliana and Robyn Meeks**, “Energy Efficiency and Electricity Reliability,” *The Review of Economics and Statistics*, July 2021, 103 (3), 461–475.
- Chen, Jiafeng and Jonathan Roth**, “Logs with zeros? Some problems and solutions,” *The Quarterly Journal of Economics*, 30 March 2024, 139 (2), 891–936.
- Cooper, Adam and Mike Shuster**, “Electric Company Smart Meter Deployments: Foundation for a Smart Grid (2021 update),” Technical Report, Institute for Electric Innovation, Washington, DC April 2021.
- Costa-Campi, Maria Teresa, Daniel Daví-Arderius, and Elisa Trujillo-Baute**, “The economic impact of electricity losses,” *Energy Economics*, September 2018, 75, 309–322.
- Cutler, D.**, “Where Are the Health Care Entrepreneurs? The Failure of Organizational Innovation in Health Care,” *Innovation Policy and the Economy*, 2011, 11 (1), 1–28.
- de Chaisemartin, C. and X. D’Haultfoeuille**, “Two-Way Fixed Effects Estimators with Heterogeneous Treatment Effects,” *American Economic Review*, 2020, 110 (9), 2964–2996.
- Draca, M., R. Sadun, and J. Van Reenen**, “Productivity and ICTs: A Review of the Evidence,” *The Oxford Handbook of Information and Communication Technologies*, 2009.
- Duggan, Mark**, “Hospital ownership and public medical spending,” *The Quarterly Journal of Economics*, 2000, 115 (4), 1343–1373.
- , **Atul Gupta, Emilie Jackson, and Zachary Templeton**, “The Impact of Privatization: Evidence from the Hospital Sector,” *NBER Working Paper 30824*, 2023.
- Duke Energy Progress**, “Smart Grid Frequently Asked Questions,” 2020. <https://www.duke-energy.com/our-company/about-us/smart-grid/smart-meter>.
- EIA**, “U.S. electric system is made up of interconnections and balancing authorities,” 2016.
- EIA**, “Today in Energy,” Nov 2021. <https://www.eia.gov/todayinenergy/detail.php?id=50316>.
- , “U.S. EIA Frequently Asked Questions,” Nov 2022. <https://www.eia.gov/tools/faqs/faq.php?id=108&t=1>.



- EIA**, “U.S. electricity customers averaged five and one-half hours of power interruptions in 2022,” 2024. <https://www.eia.gov/todayinenergy/detail.php?id=61303>.
- EPRI**, “Advanced Metering Infrastructure Technology: Limiting Non-Technical Distribution Losses in the Future,” Technical Report 2008.
- Fenizia, Alessandra**, “Managers and Productivity in the Public Sector,” *Econometrica*, 2022, *90* (3), 1063–1084.
- FERC**, “Federal Energy Regulatory Commission Reliability Primer: An Overview of the Federal Energy Regulatory Commission’s Role in Overseeing the Reliable Operation of the Nation’s Bulk Power System,” 2020.
- Fisher-Vanden, Karen, Erin T. Mansur, and Qiong Juliana Wang**, “Electricity Shortages and Firm Productivity: Evidence from China’s Industrial Firms,” *Journal of Development Economics*, 2015, *114*, 172–188.
- Flammer, C. and P. Bansal**, “Does a Long-Term Orientation Create Value? Evidence from a Regression Discontinuity,” *Strategic Management Journal*, 2017, *38*, 1827–1847.
- Freyaldenhoven, S., C. Hansen, and J. Shapiro**, “Pre-Event Trends in the Panel Event-Study Design,” *American Economic Review*, 2019, *109* (9), 3307–3338.
- Gold, Rachel, Corri Waters, and Dan York**, “Leveraging Advanced Metering Infrastructure To Save Energy,” *American Council for an Energy-Efficient Economy (ACEEE)*, January 2020, *Report U2001*.
- Goldfarb, Avi and Catherine Tucker**, “Digital Economics,” *Journal of Economic Literature*, 2019, *57* (1), 3–43.
- Goodman-Bacon, Andrew**, “Difference-in-differences with variation in treatment timing,” *Journal of Econometrics*, 2021, *225* (2), 254–277.
- Gosnell, G., J. List, and R. Metcalfe**, “The Impact of Management Practices on Employee Productivity: A Field Experiment with Airline Captains,” *Journal of Political Economy*, 2020, *128* (4).
- Greenough, J.**, “The Smart Meter Report: Forecasts, regional breakdowns, costs, and savings for a top IoT device,” 2015. Business Insider, April 9, 2015. Available at: <https://www.businessinsider.com/the-smart-meter-report-a-look-at-how-the-smart-meter-market-is-evolving-2015-3#:~:text=The%20cost%20of%20installing%20one,the%20installation%20of%20smart%20meters,AccessedSeptember2023>.
- Hart, Oliver, Andrei Shleifer, and Robert Vishny**, “The proper scope of government: theory and an application to prisons,” *The Quarterly Journal of Economics*, 1997, *112* (4), 1127–1161.
- IEA**, “Energy Technology Perspectives 2015: Mobilising Innovation to Accelerate Climate Action,” Technical Report 2015.

- , *Electricity Grids and Secure Energy Transitions: Enhancing the Foundations of Resilient, Sustainable and Affordable Power Systems*, OECD, October 2023.
- Ito, Koichiro, Takanori Ida, and Makoto Tanaka**, “Moral Suasion and Economic Incentives: Field Experimental Evidence from Energy Demand,” *American Economic Journal: Economic Policy*, 2018, 10 (1), 240–267.
- Janke, K., C. Propper, and R. Sadun**, “The Impact of CEOs in the Public Sector: Evidence from the English NHS,” *Working Paper 25853*, 2019.
- Jessoe, Katrina and David Rapson**, “Knowledge Is (Less) Power: Experimental Evidence from Residential Energy Use,” *American Economic Review*, 2014, 104 (4), 1417–1438.
- Jiménez, Raúl, Tomás Serebrisky, and Jorge Mercado**, *Power Lost: Sizing Electricity Losses in Transmission and Distribution Systems in Latin America and the Caribbean*, Inter-American Development Bank, November 2014.
- Joskow, Paul L**, “Creating a Smarter U.S. Electricity Grid,” *Journal of Economic Perspectives*, February 2012, 26 (1), 29–48.
- List, John, Robert Metcalfe, and Michael Price**, “Smart Meters: Do Their Prices Matter to Their Adoption and Do They Save Energy?,” *Working Paper*, 2018.
- Malik, Naureen**, “Unpredictable Power Surges Threaten US Grid - And Your Home,” 2024. Bloomberg Business, Available at: <https://www.bloomberg.com/news/features/2024-02-15/us-grids-face-unpredictable-power-surges-with-potentially-dangerous-consequences?embedded-checkout=true>, Accessed May 2024.
- Meeks, Robyn C., Arstan Omuraliev, Ruslan Isaev, and Zhenxuan Wang**, “Impacts of electricity quality improvements: Experimental evidence on infrastructure investments,” *Journal of Environmental Economics and Management*, 2023, 120, 102838.
- Metcalfe, Robert D., Alexandre B. Sollaci, and Chad Syverson**, “Managers and Productivity in Retail,” *Working Paper*, 2023.
- Mukherjee, A.**, “Impacts of Private Prison Contracting on Inmate Time Served and Recidivism,” *American Economic Journal: Economic Policy*, 2021, 13 (2), 408–438.
- Munasinghe, Mohan**, “Electricity Pricing; a Comprehensive Framework,” *IEEE Transactions on Power Apparatus and Systems*, August 1981, PAS-100 (8), 3959–3968.
- Nangia, Varun, Samuel Oguah, and Kwawu Gaba**, *Can Utilities Realize the Benefits of Advanced Metering Infrastructure?: Lessons from the World Bank’s Portfolio*, World Bank, Washington, DC, July 2016.
- Otero, Cristobal and Pablo Munoz**, “Managers and Public Hospital Performance,” *Working Paper*, 2022.

- Public Utility Commission of Texas**, “A Report on Advanced Metering as Required by House Bill 2129,” *Report to the 82nd Texas Legislature*, September 2010.
- Rose, N. and P. Joskow**, “The Diffusion of New Technologies: Evidence from the Electric Utility Industry,” *RAND Journal of Economics*, 1990, 21 (3).
- Roth, J., P.H. Sant’Anna, A. Bilinski, and J. Poe**, “What’s Trending in Difference-in-Differences? A Synthesis of the Recent Econometrics Literature,” *conditionally accepted, Journal of Econometrics*, 2022.
- Roth, Jonathan**, “Pretest with Caution: Event-Study Estimates after Testing for Parallel Trends,” *American Economic Review: Insights*, 2022, 4 (3), 305–322.
- Shadle, Dave**, “Are Utility Electrical Losses Declining?,” 2022. <https://www.tdworld.com/overhead-transmission/article/21246497/are-utility-electrical-losses-declining>.
- Shleifer, Andrei**, “State versus Private Ownership,” *Journal of Economic Perspectives*, 1998, 12 (4), 133–150.
- Sprinz, James**, “Global trends in smart metering,” *Smart Energy International*, December 2018.
- Strong, Derek Ryan**, “The Early Diffusion of Smart Meters in the US Electric Power Industry,” preprint, Thesis Commons April 2018.
- Sun, Liyang and Sarah Abraham**, “Estimating dynamic treatment effects in event studies with heterogeneous treatment effects,” *Journal of Econometrics*, 2021, 225 (2), 175–199.
- Trimble, Chris, Masami Kojima, Ines Perez Arroyo, and Farah Mohammadzadeh**, “Financial Viability of Electricity Sectors in Sub-Saharan Africa: Quasi-Fiscal Deficits and Hidden Costs,” Technical Report, The World Bank 2016.
- U.S. Department of Energy**, “Fault Location, Isolation, and Service Restoration Technologies Reduce Outage Impact and Duration,” Technical Report 2014.
- , “Municipal Utilities’ Investment in Smart Grid Technologies Improves Services and Lowers Costs,” *Smart Grid Investment Grant Program (SGIG) Reports on Technology Applications and Results*, 2014.
- , “Smart Grid Investments Improve Grid reliability, Resilience and Storm Responses,” Technical Report 2014.
- , “Advanced Metering Infrastructure and Customer Systems: Results from the SGIG Program,” 2016.
- , “Advanced Metering Infrastructure and Customer Systems: Results from the Smart Grid Investment Grant Program,” Technical Report 2016.

**USAID**, “Optimal Feeder Level Connection: Training and Field Support Toolkit,” Technical Report, USAID 2009.

**Utility Dive**, “97% of smart meters fail to provide promised customer benefits. Can \$3B in new funding change that?,” 2022. Utility Dive, Available at: <https://www.utilitydive.com/news/97-of-smart-meters-fail-to-provide-promised-customer-benefits-can-3b-in/632662/>, Accessed December 2023.

**Wolak, Frank A.**, “Do Residential Customers Respond to Hourly Prices? Evidence from a Dynamic Pricing Experiment,” *American Economic Review*, 2011, *101* (3), 83–87.

**Zhang, Fan**, “In the Dark: How Much Do Power Sector Distortions Cost South Asia?,” Technical Report, The World Bank 2018.

## Main Text Tables

**Table 1:** Summary Statistics of Key Variables (Main Estimation Sample)

	Full Sample (1)	AMI Adopters Pre-Adoption Years (2)	Non-Adopters All Years (3)	Difference in Means (4)
Loss Rate (%)	0.052 (0.026)	0.052 (0.024)	0.054 (0.028)	0.002 (0.001)
Total Losses (000s MWh)	65.77 (275.46)	83.00 (340.86)	37.73 (132.40)	-45.27 (4.68)
Total Sales (000s MWh)	1160 (4284)	1430 (5093)	686 (2522)	-744.2 (73.9)
Total Revenue (million)	119.5 (498.2)	139.3 (569.0)	68.1 (240.4)	-71.2 (7.94)
Number of Customers (000s)	57.01 (258.05)	62.27 (271.13)	33.70 (127.50)	-28.58 (3.88)
Sales per Customer (MWh)	31.00 (140.51)	27.01 (17.15)	36.39 (206.42)	9.38 (3.18)
Rev. per Customer (000s)	2.88 (11.94)	2.43 (1.12)	3.33 (17.57)	0.896 (0.270)
Average Prices (\$/kWh)	0.102 (0.034)	0.097 (0.028)	0.102 (0.039)	0.005 (0.001)
Observations	14,252	4,239	6,546	10,785
Number of Utilities	1,304	704	600	1,304

*Notes:* Table provides summary statistics of key variables used in the utility-level analysis. Column 1 includes the full estimation sample, Column 2 includes only pre-treatment years for utilities that deploy AMI between 2010 and 2016, and Column 3 includes all years for utilities that do not deploy AMI through our sample period. The differences of the means are in Column 4. Standard errors are in parentheses. Data are from the Energy Information Administration for the years 2007 through 2017.

**Table 2:** Effect of Smart Meter Deployment on Electricity Loss Rate

<i>Dependent Variable:</i>	Loss Rate (1)	Loss Rate (2)	Loss Rate (3)	Loss Rate (4)
<b>Panel A: Main Results (Binary Treatment)</b>				
PostAMI	-0.002** (0.001)	-0.003** (0.001)	-0.003** (0.001)	-0.004** (0.002)
Observations	14,252	10,769	12,266	9,268
Estimate as % Change	3.8%	5.0%	5.8%	6.7%
Mean Pre-Treat DV	0.052	0.060	0.052	0.060
<b>Panel B: Continuous Treatment</b>				
Prop. AMI	-0.003*** (0.001)	-0.003*** (0.001)	-0.003*** (0.001)	-0.004*** (0.001)
Observations	14,252	10,769	12,266	9,268
Estimate as % Change	5.8%	5.0%	5.8%	6.7%
Mean Pre-Treat DV	0.052	0.060	0.052	0.060
<i>Sample Restrictions:</i>				
Omit Initially High Performers		x		x
Include 3+ Years Post-Adoption Only			x	x
Utility FEs	x	x	x	x
State-Year FEs	x	x	x	x
Local Market Controls	x	x	x	x

*Notes:* Table presents our main results for the change in loss rate following smart meter roll-outs. Panel A uses our primary (binary) treatment variable to estimate the effect, and in Panel B, we replace this with a continuous treatment variable measured as the proportion of a utility’s customers that have AMI. In all regressions, we estimate the model of Equation 2 following our 2SLS approach, using a one-year lead of the binary AMI treatment variable as the excluded instrument for log(population) and the year prior to initial AMI adoption (“-1”) as the omitted year. Local market controls include population and new building construction within counties that the utility serves. Coefficients on the instrumental variable in the first stages are between 0.007 and 0.014 and statistically significant at least at the 10% level in each case. Mean values of dependent variable are calculated using pre-treatment observations for AMI adopters. Standard errors are clustered at the utility level. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

**Table 3:** Provision of Complementary Products

<i>Dependent Variable:</i>	Dyn. Pricing (1)	Dem. Resp. (2)	Sales/ Cust. (3)	Sales/ Cust. (4)	Loss Rate (5)	Loss Rate (6)
PostAMI	0.039** (0.017)	0.032** (0.016)	0.020** (0.009)	0.020*** (0.007)	-0.002** (0.001)	-0.002* (0.001)
PostAMI x DP			-0.034* (0.017)		0.001 (0.001)	
DP			0.013 (0.016)		-0.001 (0.002)	
PostAMI x DR				-0.053*** (0.019)		-0.000 (0.001)
DR				0.024* (0.013)		-0.001 (0.001)
Observations	14,252	14,252	14,252	14,252	14,252	14,252
Mean Pre-Treat DV	0.207	0.112	3.18	3.18	0.052	0.052
Utility FEs	x	x	x	x	x	x
State-Year FEs	x	x	x	x	x	x
Local Mkt. Controls	x	x	x	x	x	x

*Notes:* Table presents results related to products that could enhance the benefits of AMI (dynamic pricing and demand response programs). In Columns 1-2, dependent variables are indicators for whether utilities offer dynamic pricing or demand response programs, respectively. In Columns 3-4, the dependent variable is (logged) sales per customer, and in Columns 5-6, it is the loss rate. In all regressions, we estimate the model of Equation 2 following our 2SLS approach, using a one-year lead of the AMI treatment variable as the excluded instrument for log(population) and the year prior to initial AMI adoption (“-1”) as the omitted year. Mean values of dependent variable are calculated using pre-treatment observations for AMI adopters. Standard errors are clustered at the utility level. Asterisks denote \* $p < 0.10$ , \*\* $p < 0.05$ , \*\*\* $p < 0.01$ .



**Table 4:** Investing in Complementary Organizational Capital

<i>Dep. Var. (log):</i>	Number of Employees			
	(1)	(2)	(3)	(4)
PostAMI $\times$ Meter Readers	-0.186*** (0.041)	-0.182*** (0.041)		
PostAMI $\times$ Quant Workers			0.074*** (0.019)	0.068*** (0.019)
Observations	100,340	95,642	100,340	97,500
MSA-Occupation FEs	x	x	x	x
MSA-Year FEs	x	x	x	x
Drop Quant Workers		x		
Drop Meter Readers				x

*Notes:* Table provides results from estimating effects of AMI on the number of employees in meter reader (Columns 1-2) and quantitative data analysis-oriented (Columns 3-4) occupations. Dependent variable is log(employment) and data are at the MSA-occupation-year level. Standard errors are clustered by MSA. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

**Table 5:** Impact of Smart Meters on Power Outages in Texas

<i>Dependent Variable:</i>	Outage Duration (SAIDI)		Outage Frequency (SAIFI)	
	(1)	(2)	(3)	(4)
PostAMI	-0.071*** (0.026)	-0.082*** (0.029)	-0.002 (0.021)	-0.024 (0.023)
Observations	61,154	61,154	61,148	61,148
Mean Pre-Treat DV	93.27	93.27	0.966	0.966
Feeder FEs	x	x	x	x
Year FEs	x	x	x	x
Local Market Controls	x	x	x	x
Utility-Year Trends		x		x


*Notes:* This table reports the effects of AMI deployment on electricity reliability in Texas, using within-utility feeder line-level data and a Poisson model. We implement a control function approach to accommodate the 2SLS framework within the Poisson estimation. The dependent variable is SAIDI (power outage duration in minutes) in Columns 1–2 and SAIFI (outage frequency) in Columns 3–4. Additional local market controls include new building construction and log population. The lead AMI treatment variable serves as the excluded instrument for log(population) in the first stage. The original sample consists of 61,234 observations. The estimation drops 80 observations for SAIDI and 86 for SAIFI due to singleton units or separation by fixed effects. Standard errors are estimated using bootstrap procedures clustered at the feeder line level. Asterisks denote statistical significance: \* $p < 0.10$ , \*\* $p < 0.05$ , \*\*\* $p < 0.01$ .

**Table 6:** Financial Implications - Changes in Revenue and Prices Across All Utilities


<i>Dep. Var. (log):</i>	Total Revenue		Average Prices	
	(1)	(2)	(3)	(4)
<b>Panel A: Full Sample</b>				
PostAMI	0.009* (0.005)	0.014** (0.006)	-0.003 (0.004)	-0.003 (0.005)
Observations	14,252	10,769	14,252	10,769
<b>Panel B: 3+ Years Post-Adoption</b>				
PostAMI	0.017* (0.010)	0.022* (0.012)	-0.006 (0.007)	-0.005 (0.009)
Observations	12,266	9,268	12,266	9,268
Mean Pre-Treat DV (Levels)	\$139.3M	\$141.6M	\$0.097/kWh	\$0.102/kWh
Omit Initially High Performers		x		x
Utility FEs	x	x	x	x
State-Year FEs	x	x	x	x
Local Market Controls	x	x	x	x

*Notes:* Table presents estimates of the effects of smart meter roll-outs on (logged) total revenue (Columns 1-2) and average prices (Columns 3-4). In all regressions, we estimate the model of Equation 2 following our 2SLS approach, using a one-year lead of the AMI treatment variable as the excluded instrument for log(population) and the year prior to initial AMI adoption (“-1”) as the omitted year. The full sample is used in Panel A, and in Panel B, we omit the initial year of deployment and the two years that follow. Local market controls include population and new building construction within counties that the utility serves. Mean values of dependent variable are calculated using pre-treatment observations for AMI adopters. Standard errors are clustered at the utility level. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

## Main Text Figures

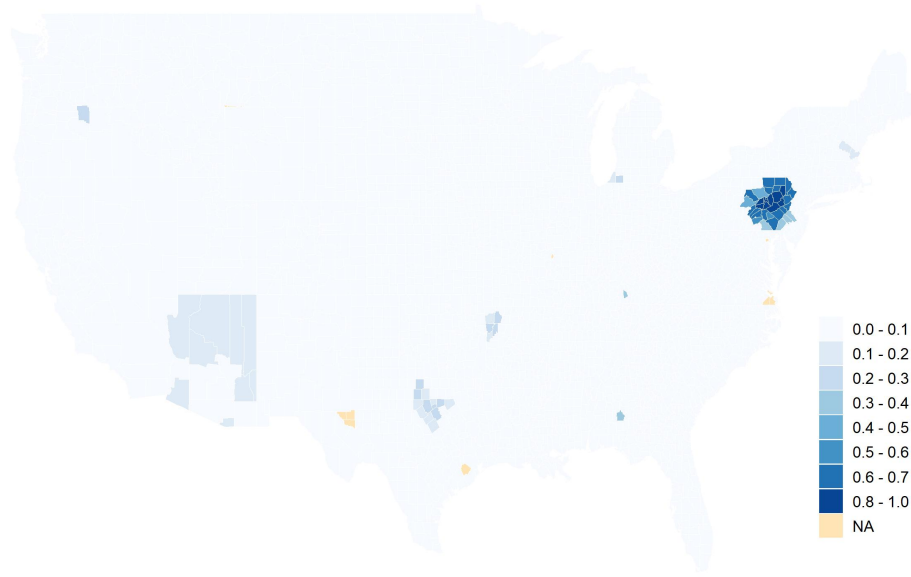


(a) 2007

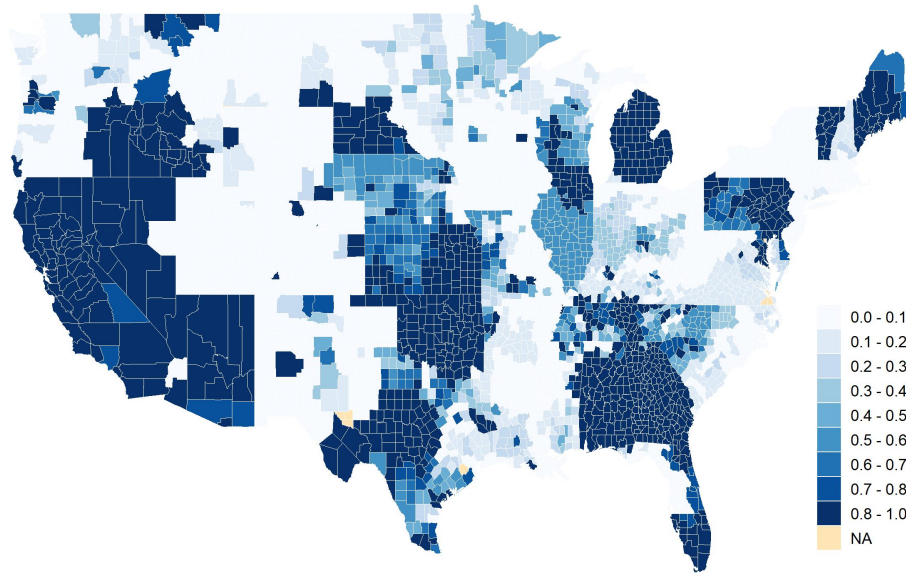

(b) 2017


**Figure 1:** AMI Meter Adoption in 2007 versus 2017

*Notes:* Maps show the proportion of customers with AMI by county in 2007 (Panel A) and 2017 (Panel B), illustrating how AMI smart meter deployment increased dramatically through this time period. Created by authors using data from the Energy Information Administration (Form EIA-861)

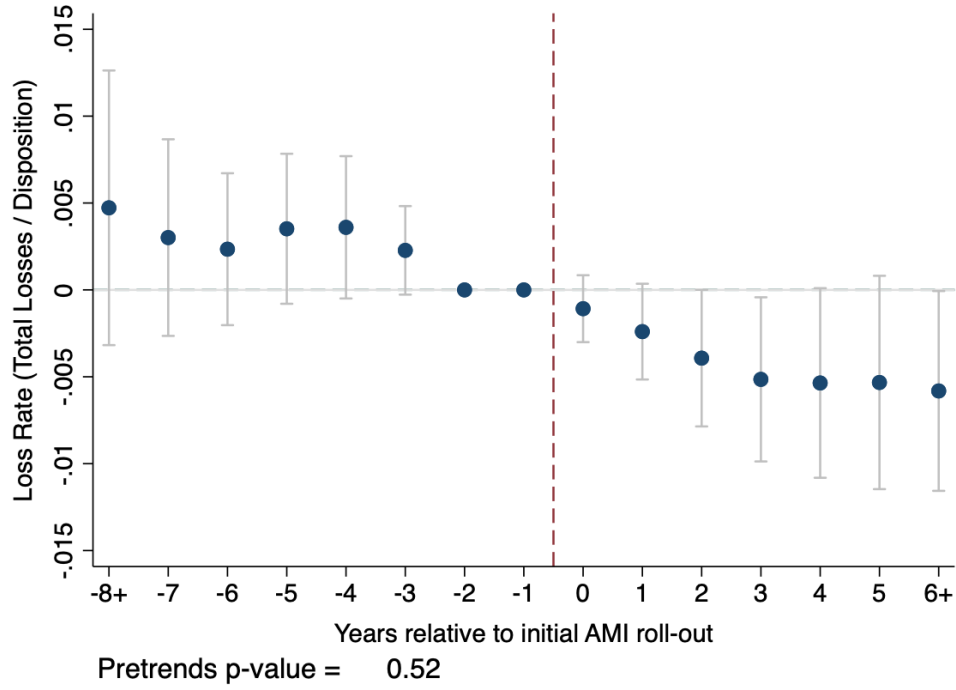


**Figure 2:** Effect of Smart Meter Deployment on Electricity Loss Rate

*Notes:* Figure illustrates main results for the effect of AMI deployment on electricity loss rates. Plot provides coefficients  $\beta_j$  and their 95 percent confidence intervals from estimating Equation 1 with our 2SLS estimator, using a one year lead of the AMI treatment variable as the excluded instrument for  $\log(\text{population})$  and omitting the year prior to initial AMI adoption (“-1”). Utility and state-year fixed effects as well as local market controls are included. Standard errors are clustered at the utility level.

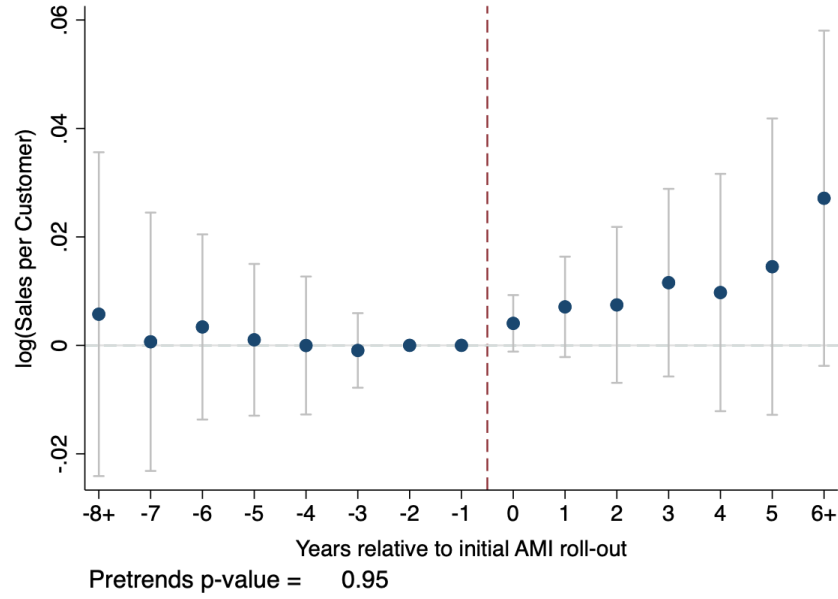


**Figure 3:** Effect of Smart Meter Deployment on Sales per Customer


*Notes:* Figure illustrates effect of AMI deployment on (logged) sales per customer. Plot provides coefficients  $\beta_j$  and their 95 percent confidence intervals from estimating Equation 1 with our 2SLS estimator, using a one year lead of the AMI treatment variable as the excluded instrument for  $\log(\text{population})$  and omitting the year prior to initial AMI adoption (“-1”). Utility and state-year fixed effects as well as local market controls are included. Standard errors are clustered at the utility level.

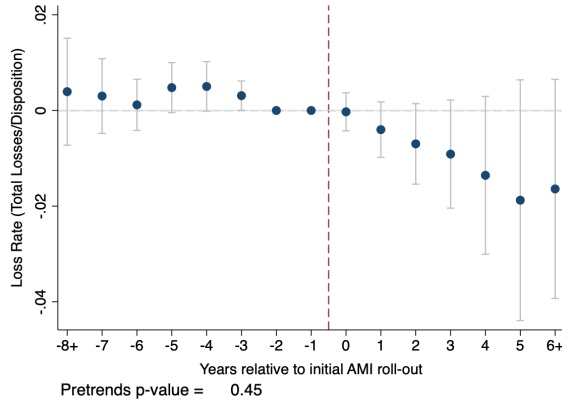

(a) Government-Owned Utilities

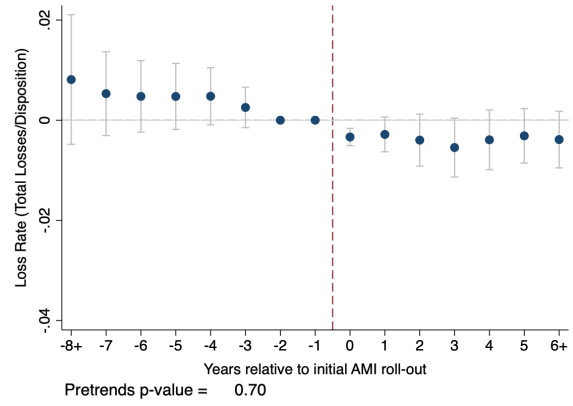

(b) Cooperatives

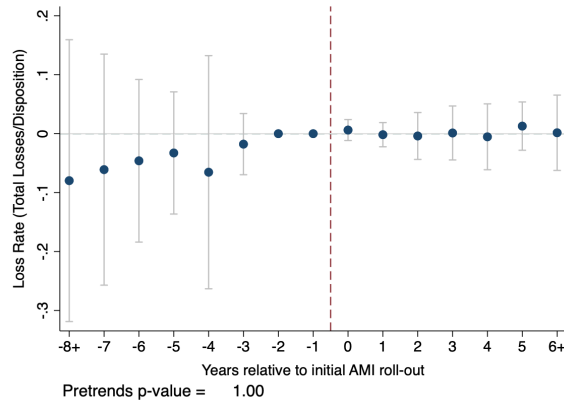


(c) Investor-Owned Utilities

**Figure 4:** Heterogeneity in Smart Meter Effects on Loss Rates by Utility Ownership

*Notes:* Figure illustrates heterogeneous effects of AMI deployment on loss rates by utility ownership. Plots provide coefficients and their 95 percent confidence intervals from estimating Equation 1 separately for government-owned utilities (Panel A), investor-owned utilities (Panel B), and cooperatives (Panel C) using our 2SLS estimator approach and omitting the year prior to initial AMI adoption (“-1”). Utility fixed effects, state-year fixed effects, and local market controls are included. Standard errors are clustered by utility.



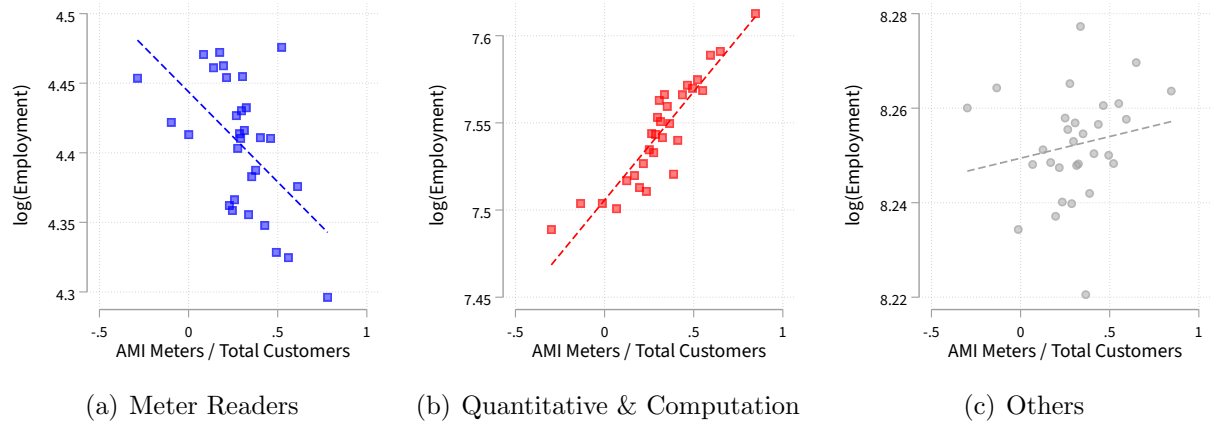

**Figure 5:** Meter Readers, Quant-Related Jobs, and Other Occupations as AMI Deployment Increases

*Notes:* Figure plots relationship between the proportion of customers with AMI meters and number of employees in the utility sector that are meter readers (Panel A), quantitative and computation workers (Panel B), and other occupations (Panel C). Labor data are at the MSA-occupation level and are aggregated into bins. The outcome variable on the vertical axis is the residual of  $\log(\text{employment})$  after controlling for MSA fixed effects and local market characteristics (population and new building units).

# Online Appendix

## Can Digitalization Improve Public Services? Evidence from Innovation in Energy Management

<b>A</b>	<b>Additional Background on AMI in the U.S.</b>	<b>SI-1</b>
<b>B</b>	<b>Data and Sample Construction</b>	<b>SI-4</b>
<b>C</b>	<b>Additional Tables</b>	<b>SI-8</b>
<b>D</b>	<b>Additional Figures</b>	<b>SI-17</b>

# A Additional Background on AMI in the U.S.

## A1 Drivers of AMI Adoption in the United States

Digitization of the electricity grid initially progressed slowly in the U.S. Some of the main factors affecting initial roll-out included financial barriers, differential state support for AMI, a lack of regulatory standards, and utility learning about the technology (Guo, Bond and Narayanan 2015; Strong 2018). In the paragraphs that follow, we discuss how alleviating constraints related to each of these factors likely helped to deliver AMI adoption in the United States.

**Alleviating financial constraints:** Since the mid-2000s, utility AMI investments have increased, which is at least partially attributable to government efforts. At the federal level, government efforts started with the Energy Policy Act of 2005, which provided a policy framework for AMI. The Energy Independence and Security Act of 2007 was then enacted “to support the modernization of the Nation’s electricity transmission and distribution system, to maintain a reliable and secure electricity infrastructure that can meet the future demand growth” (Public Utility Commission of Texas 2010). This act tasked the U.S. Department of Energy with detecting barriers to smart grid technology adoption, while also deploying funding and encouraging states to permit utilities to recover the costs of investing in AMI.

Adoption substantially increased with the introduction of federal funding for AMI, alleviating financial barriers. The American Recovery and Reinvestment Act of 2009 directed substantial amounts of federal funding towards AMI (U.S. Department of Energy 2012b). As of 2012, \$3.4 billion had been invested in federal funds through the Smart Grid Investment Grant (SGIG) program. Given private sector matching funds were required, the program increased investment in AMI by nearly \$8 billion as of 2012 (U.S. Department of Energy 2012b). The SGIG program, which funded a total of 99 projects across the country (U.S. Department of Energy 2012a), was intended to accelerate the installation of smart grid technologies in four areas with investments in AMI being one of the four. The program did induce greater adoption of AMI and the number of smart meters installed increased fourfold between 2007 and 2011 (Gold et al. 2020). As we show in Appendix Figure D1, Panel A, installations by utilities have increased steadily since 2007.

The cost of smart meters in the market have also declined over time, which also is another channel through which the financial constraints of AMI adoption were alleviated over time (Strong 2018; Guo et al. 2015).

**Increasing state support:** There is considerable heterogeneity in AMI adoption rates across states. These differences are likely correlated with variation in the extent to which relevant studies, policies, and legislation were carried out in the states (EIA 2012). Strong (2018) finds state support for AMI adoption is positively correlated with adoption, but this relationship is not always statistically significant. In some states—although not all—regulatory approval is required to approve utilities’ plans for AMI cost recovery (EIA 2017). The U.S. Energy Information Administration (EIA) tracked smart grid legislative regulatory policies by state through at least 2011 (see, e.g., EIA 2011).

**Developing regulatory standards:** Some utilities have indicated that they waited for certain industry technology standards to be developed and finalized before investing in AMI. One main example of this is the development of an interoperability standard, which

was finalized in 2012 ([Strong 2018](#)).

**Learning about the technology:** Evidence also suggests at least two forms of learning—learning by doing and learning from others—played a role in the steady increase of AMI deployment ([Strong 2018](#)). Such learning would affect both the deployment of AMI by the utility over time as well as the benefits the utility (and potentially the customers as well) derive from the installation of AMI.

## A2 Expected Benefits of AMI Deployment

Government and industry reports cite a number of benefits from deploying AMI that accrue to the utilities and customers. Many of the expected benefits are linked to the two-way transmission of data permitted by AMI, which is claimed to help improve utility operational efficiency in multiple respects.

AMI’s remote transmission of electricity consumption data can reduce the reliance on employees to manually read meters. This can remove the need to estimate or interpolate bills when meter reading is not possible and decrease overall human error in the billing process ([Nangia et al. 2016](#); [Cooper and Shuster 2021](#)). Customer complaints decrease and billing disputes resolve more quickly ([U.S. Department of Energy 2016](#)).

Utilities can use the real-time information to improve billing processes and efficiency, enhance forecasting capabilities, balance supply and demand more precisely, decrease outage response times, identify bottlenecks or other potential threats to the grid, improve safety, and improve overall grid operations including within the transmission and distribution systems ([Nangia et al. 2016](#); [Gold et al. 2020](#); [Public Utility Commission of Texas 2010](#)).

In terms of improving reliability, AMI meters can help in several ways. First, they assist in identifying outages faster and expediting service restoration. For example, smart meters are often enabled with a “last gasp” alarm, which informs the utility at the time when an outage occurs and then again when power is restored ([U.S. Department of Energy 2014](#)). Of the 99 projects funded through the SGIG program, 48 projects had the explicit goal of improving electric distribution reliability ([U.S. Department of Energy 2012a](#)).<sup>50</sup> Second, smart meters allow utilities to remotely disconnect customers—such as those who agree to allow utilities to do so when needed by enrolling in demand response programs—at times when either wholesale electricity prices are particularly high or the electrical system is stressed ([Public Utility Commission of Texas 2010](#)), which can help avoid outages and distribution system damages altogether.

Some, although not all, of these operational efficiencies—such as the faster, remote identification of outage locations—also benefit utility customers. For example, EIA documentation notes that AMI “can support demand response and distributed generation, ... [and] provide information that consumers can use to save money by managing their use of electricity” ([EIA 2017](#)). Others note the role of AMI and the additional functionalities that AMI can enable—which can help utility customers realize the many of the benefits of AMI

---

<sup>50</sup>According to the DOE, these 48 projects had one or more of the following goals: “(1) reducing the frequency of both momentary and sustained outages, (2) reducing the duration of outages, and (3) reducing the operations and maintenance costs associated with outage management” ([U.S. Department of Energy 2012a](#)).

(e.g., lower costs and improving understanding of prices and billing)—have by and large been underutilized by many utilities (Gold et al. 2020).

### A3 Valuing the Returns to AMI Deployment

The benefits of AMI vary across utilities depending on a number of factors, such as the utilities’ baseline infrastructure, the functions of the AMI employed, the characteristics of the territory served (such as how remote it is), and the complementary investments utilities make.

Early on, federal and state agencies underscored the need to methodologically enumerate and estimate the benefits and costs of AMI deployment projects. Considerable effort has been invested in developing methodological approaches to defining, categorizing, and estimating both benefits and costs from the ratepayers perspective (see, e.g., [Electric Power Research Institute 2010 2012](#)). In some states, electricity utilities provided testimony to their state public utilities commissions to provide assurance that the benefits of these project outweigh the costs (for early examples see, e.g., [Southern California Edison 2006](#); [Public Utility Commission of Texas 2010](#)). To understand the expectations of AMI’s benefits to individual utilities would therefore require examining, on a case-by-case base, the utility testimonies to their state public utility commissions, where they are available.

Ex ante studies on the adoption of smart grids (and associated dynamic pricing policies) find benefit-cost ratios greater than 1, however some have indicated that not all of the benefits included in those calculations actually came to fruition ([Guo et al. 2015](#)). This could be the result of utilities not employing all the potential functions permitted by the AMI.

The magnitude of AMI benefits relative to the costs depends on the specific utility’s needs and use of the technology. There are some states and smaller jurisdictions that have not approved their utility’s proposal to install AMI, with the common opposition to AMI being the magnitude of their costs relative to their expected benefits (or uncertainty in those expected benefits) ([Gold et al. 2020](#)). In contrast, however, documentation on the SGIG program reports large O&M cost savings for some AMI projects, including one project that saved \$174 million alone ([U.S. Department of Energy 2016](#)).

## B Data and Sample Construction

### B1 Utility-Level Data

We assemble utility-level information on basic characteristics, operations, sales, and meter adoption for the period 2007–2018 from the Energy Information Administration (EIA) forms and S&P Global. We restrict our sample to the contiguous U.S. (not including Alaska, Hawaii, or other offshore territories).

**Basic Characteristics.** We use S&P Global, EIA Forms 860 and 861 to construct detailed data on utility-level basic characteristics, including location, county-level service territory, ISO, FERC region, regulation status, ownership type (i.e., cooperative, investor-owned, government agencies, etc.), and electric activities (i.e., generation, transmission, and distribution).

**Advanced Metering.** Advanced metering information is derived from Schedule 6 of EIA-861. Since 2007, the data reports the number of electric meters by state, customer category, and meter type, including automated meter reading (AMR) and advanced metering infrastructure (AMI). In addition to smart meter adoption, these data also include the number of customers with the following advanced technology features enabled by the AMI since 2013: (1) digital access to daily energy usage; (2) home area network (HAN) gateway that allows the meter to communicate with customer’s devices; (3) direct load control (LC) that permits remote shutdown or cycle a customer’s electrical equipment on short notice. We aggregate the data to the utility level and calculate the total number of AMR and AMI per utility in each year. For any missing values in the number of AMI for certain years, we impute them using the value from the nearest available year prior to the missing year.

**Operations.** Operational data comes from EIA-861. We collect utility-level total electricity losses, which measure the amount of electricity lost from transmission and distribution. We drop the records with negative loss values as these are likely mistakes in EIA’s data collection and reporting process. We then calculate the electricity loss rate as the share of total electricity losses relative to total electricity disposition. EIA-861 also reports detailed sales and revenue information, which is decomposed into different parts, including retail sales to ultimate customers (i.e., electricity sold to customers purchasing electricity for their own use and not for resale), sales for resale (i.e., electricity sold for resale purposes), delivery customers (i.e., unbundled customers who purchase electricity from a supplier other than the electric utility that distributes power to their premises), transmission of electricity, and other electric activities. For the retail sales to ultimate customers, EIA-861 has information on sales, revenues, and customer counts by four customer categories, including residential, commercial, industrial, and transportation.

**Dynamic Pricing and Demand Response.** EIA-861 contains the number of customers enrolled in demand response programs (e.g., energy savings or actual peak savings) or dynamic pricing programs (e.g., time-of-use pricing or real-time pricing) by utility, state, customer category, and balancing authority. The information on aggregate customer counts for all demand response or dynamic pricing programs is available after 2007, but Specific customer count on a single program is only available after 2013. We therefore calculate the total number of customers enrolled in any demand response programs or any dynamic pricing programs for each utility in a year. For any missing values in the number of enrolled

customers, we impute them using the value from the nearest available year prior to the missing year. There are also data entry errors in the raw data where the number of enrolled customers is reported to be zero but the values in adjacent years are positive. For these cases, we replace the zeros with the non-zero values from the previous year.

**Population and Building Construction.** We supplement the utility data with measures on local population and building construction. The population data comes from the Survey of Epidemiology and End Results (SEER). It has annual population size for each county by age, race, and sex since 1969. For each year, we create two population measures based on this data: total population in a county and the size of the population older than 18. The second measure aims to capture the number of adults but excludes infants or teenagers who are unlikely to be homeowners. Data on new building units comes from the Building Permits Survey (BPS) administrated by the U.S. census. It provides annual statistics on the number and valuation of new privately owned residential housing units authorized by building permits for each county. From this data, we calculate the new and cumulative building units for the period 2007–2018. We merge these county-level population and housing data with electric utility data through their service territory information. Specifically, we sum up all the population or housing measures for the counties that a utility serves.

**Sample Construction.** We merge the utility-level annual data sets based on EIA-assigned unique utility ID and year. The combined data set at this stage contains 27,009 observations of 2,657 electric utilities. We implement a few additional cleaning steps. First, we exclude utilities that do not operate in the distribution segment of electricity delivery (23,750 observations of 2,089 utilities left). Second, we omit observations that likely represent data entry errors, such as negative losses or customer counts (21,368 observations of 1,917 utilities left). Third, for each utility, we calculate the ratio of year-specific disposition of electricity to its mean disposition and then drop the observations with such ratio larger than 2 (21,352 observations of 1,917 utilities left). These observations exhibit a sudden jump in total disposition of electricity and could be mistakes in data reporting. Fourth, we restrict to utilities that have at least 11 years of non-missing electricity losses data to maintain a high degree of panel balance (19,897 observations of 1,669 utilities left). Finally, we omit utilities that adopted AMI prior to 2010 and after 2016 such that the sample includes all utilities that never adopt and those that do adopt between 2010 and 2016. This allows us to include at least three years of pre-treatment data and one year of post-treatment data for all adopters. We also exclude extreme outliers with respect to loss rates and number of customers. We omit utilities with average pre-treatment loss rates in the top 1% or bottom 1% of the distribution of utilities' average loss rates when they have not adopted AMI as well as utilities with fewer than 20 customers. The final data set used throughout our primary analyses contains 14,252 observations of 1,304 utilities.

## B2 Feeder-Level Reliability in Texas

Feeder line data on service quality comes from the Public Utility Commission of Texas (PUCT), a state agency regulating electric, water, and telecommunication utilities. Each year, PUCT requires electric utilities to submit an annual service quality report in accordance with Substantive Rule §25.81. These reports contain detailed information on service quality and the total number of customers for each feeder line.

We focus on two international standards for measuring service reliability within an electricity distribution system: the System Average Interruption Duration Index (SAIDI) and System Average Interruption Frequency Index (SAIFI). These measures provide standardized methods of electricity service reliability such that services are comparable across utilities and over time.<sup>51</sup> Both of these address interruptions, which are defined as losses of power delivery to one or more customer. According to the IEEE Guide for Electric Power Distribution Reliability Indices, SAIFI is a measure as to how often the utility’s average customer experienced a sustained interruption in service (more than 5 minutes) within a given year. SAIDI measures the number of minutes of sustained interruptions that the utility’s average customer experiences, with interruption duration being the length of time between the start of service being interrupted and the time when service delivery is restored.

In the PUCT reports, both SAIDI and SAIFI are calculated by taking the mean of outage duration and frequency over all customers served by a feeder line in a year. Specifically, for feeder line  $i$  in year  $t$ ,

$$I_{it} = \frac{\sum_{c \in i} X_{cit}}{N_{it}}. \quad (\text{B1})$$

In the above equation,  $X_{cit}$  is the number (for SAIFI) or duration (for SAIDI) of outage events experienced by customer  $c$  served by feeder line  $i$  in year  $t$ , and  $N_{it}$  is the total number of customers. A lower SAIDI or SAIFI value means a higher level of service reliability.

**Sample Construction.** The raw feeder line data contains 104,610 observations of 11,470 feeder lines from 12 utilities during 2007-2020. We implement a few additional processing steps to construct the final data. First, we restrict the sample to 2007 – 2016. After 2016, there are mergers and acquisitions among these utilities, since which the identifiers of feeder lines owned by those utilities have completely changed. Consequently, we are not able to match those feeder lines with the pre-2016 data. We also exclude two utilities —Cap Rock and Sharyland —that experienced mergers or acquisitions before 2016. Second, we restrict to feeder lines that have at least 6 years of non-missing reliability data. Then, we match this feeder-line-level data with utility-level AMI deployment based on EIA-assigned utility ID and name. The final data set contains 68,529 observations of 7,294 feeder lines from 10 utilities in Texas.

### B3 Regional Employment Data

We assemble a dataset on occupation-level employment in each Metropolitan (MSA) and nonmetropolitan (non-MSA) area using the information from the Occupational Employment and Wage Statistics (OEWS) provided by the U.S. Bureau of Labor Statistics (BLS). It provides annual information on the number of total employment for each occupation category in each area, dating back to 1997. This area-level data, however, does not provide industry decomposition, and hence the employment represents all industries in an area. We retrieve the area-level employment data for the 2007-2018 period and restrict to the contiguous U.S.

---

<sup>51</sup>The measures are limited to an extent, as they capture interruptions but not other power quality measures, such as drops and surges in voltage.



We define an occupation as bill-collection-related labor if it belongs to the following category (with the corresponding occupation code in parenthesis): Meter Readers, Utilities (43-5041). We then drop other occupations in the same 2-digit category as those bill-collection-related ones (i.e., 43 - Office and Administrative Support Occupations). This is to mitigate the concern on spillover effects or occupation substitutions between those bill collection jobs and other office- or administration-related jobs. Then, the six-digit-level occupation data is aggregated to the two-digit level. We define jobs related to quantitative and computation if they belong to the following 2-digit occupation category: Computer and Mathematical Occupations (15-0000).

**Sample Construction.** To match this area-level employment data with AMI information, we first create county-level AMI adoption by aggregating the utility-level advanced metering data based on each utility’s service territory. Specifically, for each county and year, we sum up the number of AMI meters over all the utilities serving that county. Then, we aggregate the county-level data to the area-level using the MSA and non-MSA area definitions provided by BLS.<sup>52</sup> For the counties that are matched with more than one area, we evenly divide the number of AMI meters in those counties before doing the aggregation. The combined data set contains 140,760 observations of 22 two-digit occupation categories in 642 MSA or non-MSA areas. We made two additional steps for the data cleaning. First, we omit the observations with a positive average wage but zero number of employment, which are likely to be data reporting errors. Second, we exclude areas that never had any bill-collection-related labor throughout the sample period. The final data set contains 100,848 observations of 22 two-digit occupation categories in 434 areas.

---

<sup>52</sup>BLS provides a mapping between each county and the corresponding MSA or non-MSA area. The data is available here: [https://www.bls.gov/oes/2020/may/msa\\_def.htm](https://www.bls.gov/oes/2020/may/msa_def.htm).

## C Additional Tables

**Table C1:** Falsification Test - No Effect on Loss Rate for Utilities with Initially Low Loss Rates in Pre-Treatment Period

<i>Dependent Variable:</i>	Loss Rate (1)	Loss Rate (2)
PostAMI	0.001 (0.002)	-0.000 (0.005)
Observations	3,417	2,907
Mean Pre-Treat Dep. Var.	0.029	0.029
Utility FEs	x	x
State-Year FEs	x	x
Local Market Controls	x	x

*Notes:* Table presents coefficients from estimating effect of smart meter deployment on the loss rate when restricting the sample to only include utilities with low pre-treatment loss rates (i.e., initially high performers). Provides a falsification test, as no effect is expected. All specifications are estimated using our 2SLS procedure. Local market controls are (ihs) new construction build and (log) population, and a one-year treatment variable lead is used as the excluded instrument for (log) population. Standard errors are clustered at the utility level. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

**Table C2:** Effect of Smart Meters on Loss Rate Using OLS Instead of 2SLS

<i>Dependent Variable:</i>	Loss Rate (1)	Loss Rate (2)	Loss Rate (3)	Loss Rate (4)
<b>Panel A: Binary Treatment</b>				
PostAMI	-0.001* (0.001)	-0.002*** (0.001)	-0.002* (0.001)	-0.003** (0.001)
Observations	15,556	11,754	13,455	10,172
<b>Panel B: Continuous Treatment</b>				
Prop. AMI	-0.003*** (0.001)	-0.003*** (0.001)	-0.003*** (0.001)	-0.004*** (0.001)
Observations	15,556	11,754	13,455	10,172
<i>Sample Restrictions:</i>				
Omit Initially High Performers		x		x
Include 3+ Years Post-Adoption Only			x	x
Utility FEs	x	x	x	x
State-Year FEs	x	x	x	x
Local Market Controls	x	x	x	x

*Notes:* Table presents estimates from running the same regressions as in the main results table (Table 2) but using OLS rather than 2SLS. The dependent variable is the loss rate in all cases. Panel A uses our primary (binary) treatment variable to estimate the effect of AMI, and in Panel B, we replace this with a continuous treatment variable measured as the proportion of a utility's customers that have AMI. Local market controls are (lhs) new construction build and (log) population. Standard errors are clustered at the utility level. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

**Table C3:** Doubly-Robust Stacked Diff-in-Diff Estimates

<i>Dep. Var.:</i>	Loss Rate (1)	Loss Rate (2)	Loss Rate (3)	Loss Rate (4)
PostAMI	-0.002** (0.001)	-0.003*** (0.001)	-0.002** (0.001)	-0.003*** (0.001)
Observations	14,259	10,786	14,259	10,786
Control Group Sample	Never Treated Full	Never Treated Omit High Perf.	All Full	All Omit High Perf.
Utility FEs	x	x	x	x
Year FEs	x	x	x	x
Controls	x	x	x	x

*Notes:* Regression results from implementing the “stacked” doubly robust DiD method of Sant’Anna and Zhao (2020) based on stabilized inverse probability weighting and OLS. In Columns 1 and 2, only utilities that are never treated are included in the control group and untreated observations are included in the control group in Columns 3 and 4. In Columns 2 and 4, we omit the bottom quartile of the pre-treatment loss rate distribution (i.e., high pre-treatment performers). The dependent variable is the loss rate in all cases. Local market controls are (ihs) new construction build and (log) population. Standard errors are clustered at the utility level. Asterisks denote \* $p < 0.10$ , \*\* $p < 0.05$ , \*\*\* $p < 0.01$ .

**Table C4:** SUTVA - Investigating Whether Spillovers Bias the Results

<i>Dependent Variable:</i>	Loss Rate (1)	Imports (2)	Exports (3)
PostAMI	-0.002** (0.001)	-0.022 (0.067)	-0.082 (0.068)
Post Neighbor Deploying	0.000 (0.001)		
Observations	14,252	14,252	14,252
Utility FEs	x	x	x
State-Year FEs	x	x	x
Local Market Controls	x	x	x

*Notes:* Table provides results from tests exploring whether SUTVA might be violated. The dependent variable in Column 1 is the loss rate. In Columns 2 and 3, it is (ihs) imported and exported electricity from neighboring utilities, respectively. Neighboring utilities are defined as those serving the same county. All specifications are estimated using our baseline 2SLS procedure. Local market controls are (ihs) new construction build and (log) population, and a one-year treatment variable lead is used as the excluded instrument for (log) population. Standard errors are clustered at the utility level. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

**Table C5:** OLS Results for Provision of Complementary Products

<i>Dependent Variable:</i>	Dyn. Pricing (1)	Dem. Resp. (2)	Sales/ Cust. (3)	Sales/ Cust. (4)	Loss Rate (5)	Loss Rate (6)
PostAMI	0.071*** (0.014)	0.065*** (0.012)	0.011* (0.006)	0.014*** (0.005)	-0.001 (0.001)	-0.001 (0.001)
PostAMI x DP			-0.026* (0.015)		0.000 (0.001)	
DP			0.007 (0.011)		-0.000 (0.001)	
PostAMI x DR				-0.052*** (0.018)		-0.001 (0.001)
DR				0.024* (0.012)		-0.001 (0.001)
Observations	15,556	15,556	15,556	15,556	15,556	15,556
Utility FEs	x	x	x	x	x	x
State-Year FEs	x	x	x	x	x	x
Local Mkt. Controls	x	x	x	x	x	x

*Notes:* Table presents OLS results related to products that could enhance the benefits of AMI (dynamic pricing and demand response programs) for comparison to the 2SLS results of Table 3. In Columns 1-2, dependent variables are indicators for whether utilities offer dynamic pricing or demand response programs, respectively. In Columns 3-4, the dependent variable is (logged) sales per customer, and in Columns 5-6, it is the loss rate. In all regressions, the year prior to initial AMI adoption (“-1”) is the omitted year. Standard errors are clustered at the utility level. Asterisks denote \* $p < 0.10$ , \*\* $p < 0.05$ , \*\*\* $p < 0.01$ .

**Table C6:** Robustness Checks for Reorganization of Workers Results

<i>Dep. Var. (log):</i>	Number of Employment			
	(1)	(2)	(3)	(4)
<b>Panel A: Exclude MSAs with AMI Deployment before 2008 or after 2017</b>				
PostAMI $\times$ Billing	-0.186*** (0.041)	-0.182*** (0.041)		
PostAMI $\times$ Quant			0.070*** (0.019)	0.065*** (0.019)
Observations	56,763	54,102	56,763	55,162
<b>Panel B: Exclude MSAs with AMI Deployment before 2009 or after 2017</b>				
PostAMI $\times$ Billing	-0.189*** (0.058)	-0.187*** (0.058)		
PostAMI $\times$ Quant			0.043* (0.025)	0.037 (0.025)
Observations	32,951	31,410	32,951	31,986
MSA-Occupation FEs	x	x	x	x
MSA-Year FEs	x	x	x	x
Drop Quants		x		
Drop Meter Readers				x

*Notes:* Table provides results from estimating effects on the number of employment when restricting the sample in different ways that align with the restrictions imposed in our main analyses using utility-level data. In Panel A, we exclude MSAs with any AMI deployment before 2008 or after 2017. In Panel B, we exclude MSAs with any AMI deployment before 2009 or after 2017. Dependent variable is the logarithm of employment by MSA-occupation-year. Standard errors are clustered by MSA area. Asterisks denote \* $p < 0.10$ , \*\* $p < 0.05$ , \*\*\* $p < 0.01$ .

**Table C7:** Summary Statistics of Key Variables by Utility Ownership

	All Utilities			Adopters Pre-AMI			Non-Adopters		
	Gov (1)	Coop (2)	IOU (3)	Gov (4)	Coop (5)	IOU (6)	Gov (7)	Coop (8)	IOU (9)
Loss Rate (%)	0.048 (0.027)	0.058 (0.023)	0.054 (0.028)	0.045 (0.024)	0.058 (0.022)	0.051 (0.024)	0.050 (0.028)	0.061 (0.026)	0.057 (0.033)
Total Losses (000s MWh)	22.59 (90.10)	28.46 (35.86)	668.86 (857.39)	28.78 (94.45)	30.20 (33.70)	1051.20 (1069.21)	13.00 (21.99)	26.77 (43.97)	343.97 (402.10)
Total Sales (000s MWh)	477 (1414)	530 (732)	10948 (12950)	623 (1635)	564 (837)	16578 (14951)	273 (472)	442 (563)	6063 (8086)
Total Revenue (million)	45.9 (169.7)	52.4 (65.0)	1169.3 (1574.6)	56.2 (177.3)	52.7 (64.5)	1674.6 (1840.3)	25.1 (42.9)	44.2 (57.2)	620.7 (740.1)
No. of Customers (000s)	17.88 (60.70)	23.87 (28.02)	599.19 (838.84)	22.11 (65.39)	24.10 (25.16)	770.93 (912.61)	10.32 (21.35)	21.36 (29.28)	331.53 (389.93)
Sales per Cust. (MWh)	36.71 (190.01)	24.49 (20.31)	22.90 (14.83)	29.90 (13.13)	24.18 (20.44)	26.63 (11.05)	42.23 (251.15)	25.24 (22.50)	21.14 (16.94)
Rev. per Cust. (000s)	3.31 (16.18)	2.38 (1.38)	2.32 (1.16)	2.63 (0.94)	2.24 (1.27)	2.41 (0.77)	3.79 (21.39)	2.42 (1.56)	2.25 (1.35)
Avg. Prices (\$/kWh)	0.097 (0.028)	0.107 (0.036)	0.119 (0.058)	0.093 (0.022)	0.101 (0.031)	0.101 (0.040)	0.097 (0.031)	0.108 (0.046)	0.131 (0.067)
Observations	7,709	5,642	901	2,002	2,015	222	4,399	1,730	417
No. of Utilities	707	515	82	303	357	44	404	158	38

*Notes:* Table provides summary statistics of key variables by utility ownership separately for government-owned utilities, cooperatives, and investor-owned utilities (IOUs). Standard errors are in parentheses. Data are from the Energy Information Administration for the years 2007 through 2017.



**Table C8:** Smart Meter Deployment Intensity Effects on Loss Rates by Utility Ownership

<i>Dependent Variable:</i>	Loss Rate (1)	Loss Rate (2)	Loss Rate (3)
	<b>Gov-Owned</b>	<b>Cooperatives</b>	<b>IOUs</b>
Prop. AMI	-0.005*** (0.002)	-0.002*** (0.001)	-0.000 (0.005)
Observations	9,845	10,458	7,019
Estimate as % Change	11.1%	3.4%	0%
Mean Pre-Treat DV	0.045	0.058	0.051
Utility FEs	x	x	x
State-Year FEs	x	x	x
Local Market Controls	x	x	x


*Notes:* Table presents results for change in loss rate following AMI deployment by ownership when using a continuous treatment (proportion of customers with AMI). Results for government-owned utilities, cooperatives, and IOUs are presented separately in Columns 1-3, respectively. The control groups include all utilities without AMI despite ownership type whereas the treatment groups in each case only include utilities with AMI within a specific ownership group. In all regressions, we estimate the model of Equation 2 following our 2SLS approach, using a one-year lead of the binary AMI treatment variable as the excluded instrument for log(population) and the year prior to initial AMI adoption (“-1”) as the omitted year. Local market controls include population and new building construction within counties that the utility serves. Mean values of dependent variable are calculated using pre-treatment observations for AMI adopters. Standard errors are clustered at the utility level. Asterisks denote  $*p < 0.10$ ,  $**p < 0.05$ ,  $***p < 0.01$ .

**Table C9:** Cost-Benefit Analysis on Payback Period


Sample	Full Sample	Omit Initially High Performers	Include 3+ Years Post-Adoption	Omit Initially High Performers and Include 3+ Years Post-Adoption
	(1)	(2)	(3)	(4)
<b>A. Benefit: Revenue Increase</b>				
Estimated Avg Effect on Revenue	0.009	0.014	0.017	0.022
Avg Pre-AMI Revenue (\$ million)	139.30	141.60	139.30	141.60
Revenue Increase (\$ million)	1.25	1.98	2.37	3.12
<b>B. Cost: Meter Installation</b>				
Average Customer Numbers	62,273	66,515	62,273	66,515
Assumed Cost per Meter Installation (\$)	200	200	200	200
Total Cost (\$ million)	12.45	13.30	12.45	13.30
<b>C. Payback Period (years)</b>				
Discounting at 3%	12	8	6	5
Discounting at 5%	15	9	7	5
Discounting at 7%	18	10	7	6

*Notes:* Table presents the key components of the cost-benefit analysis used to calculate the payback period for AMI deployment. Panel A reports the estimated benefits from increased revenue due to AMI adoption, calculated by multiplying the estimated average effect of AMI on revenue (from Table 6) by the average pre-AMI revenue for AMI adopters. Panel B reports the installation costs of AMI, assuming a per-meter installation cost of \$200 based on [Greenough \(2015\)](#)'s 2015 estimate. Total installation costs are calculated by multiplying this unit cost by the average number of customers. Panel C reports the payback period in years, calculated using discount rates of 3%, 5%, and 7%. We assume that installation costs are incurred upfront, and the revenue gains from Panel A materialize as fixed annual cash flows received at the end of each year. Columns (1) through (4) correspond to different sample restrictions, aligned with the subsamples reported in Table 6.

## D Additional Figures

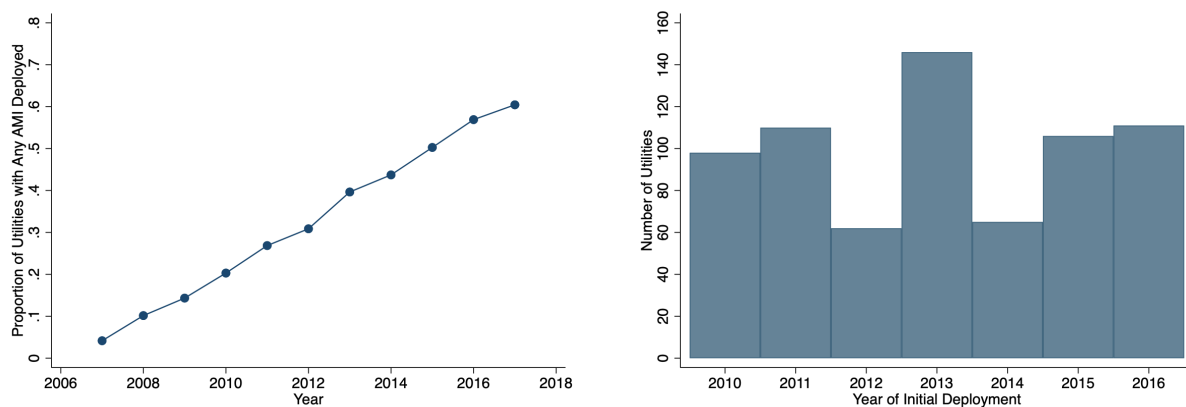


(a) Cumulative Proportion of Utilities with AMI      (b) Number of Utilities by Initial Deployment Year

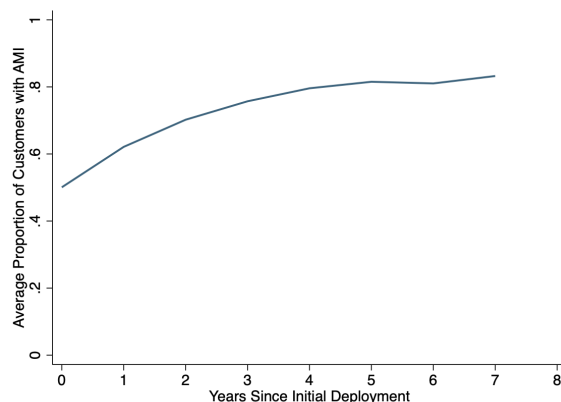

(c) Avg. Proportion of Customers with AMI


**Figure D1:** Utilities' AMI Deployment Timing and Diffusion Rates

*Notes:* Figure illustrates utilities' deployment and customers' adoption of AMI over time. Panel A plots the cumulative proportion of utilities with any AMI deployed each year from 2007 through 2017. Panel B plots the number of utilities that start to deploy AMI each year for the treated utilities included in our main estimation sample (i.e., utilities that first deploy between 2010 and 2016). Panel C plots the average proportion of utilities' customers that have AMI by the number of years following a utility's initial deployment year for the treated utilities included in our main estimation sample.

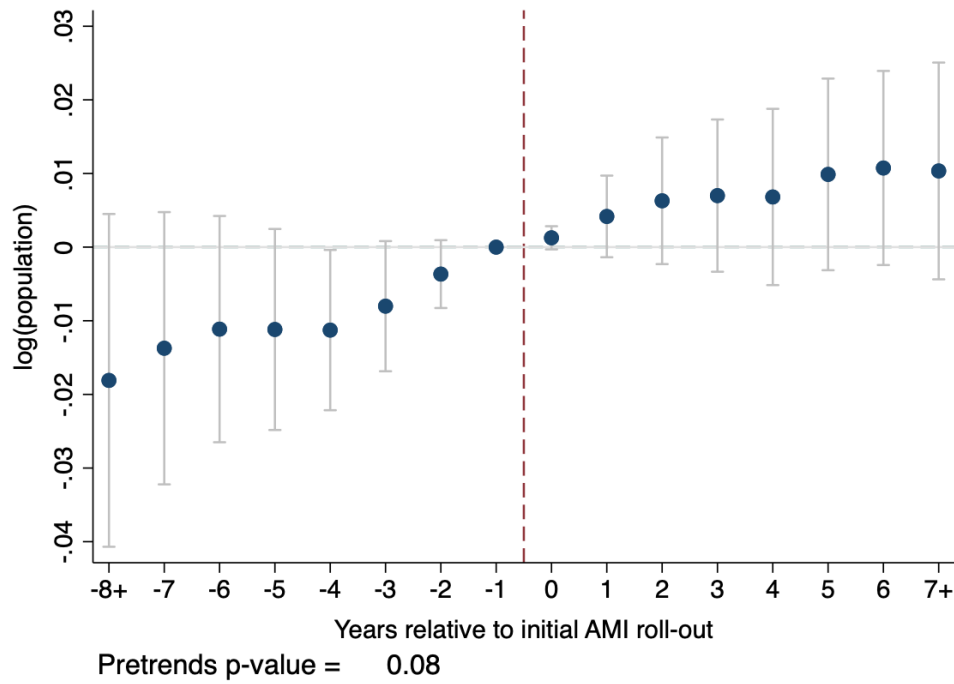


**Figure D2:** Dynamics of (Log) Population Around the First Year of Smart Meter Deployment

*Notes:* Figure plots estimates of coefficients  $\beta_j$  from Equation 1 using (log) population as the dependent variable with the year prior to initial AMI adoption (“-1”) as the omitted year. Baseline fixed effects and controls included (besides population). Standard errors are clustered at the utility level.

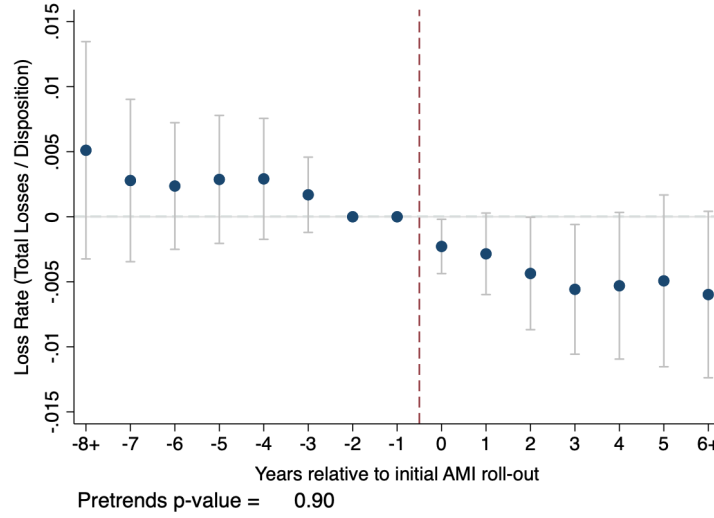


(a) High Pre-Treatment Loss Rate

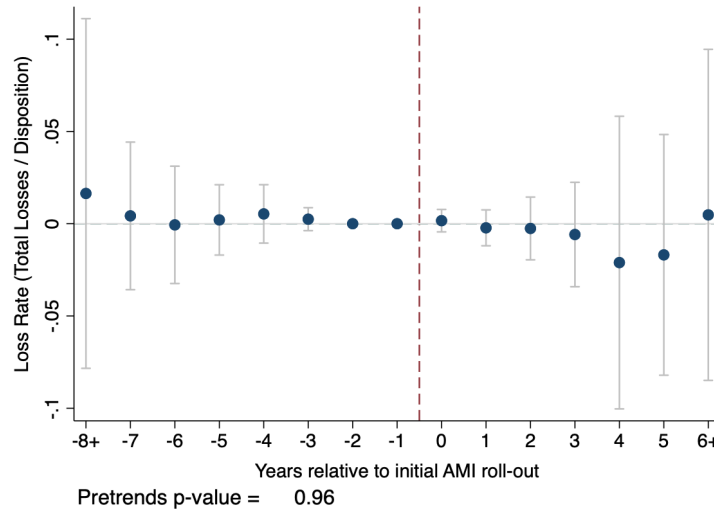


(b) Low Pre-Treatment Loss Rate

**Figure D3:** Heterogeneous Effects of Smart Meter Deployment on Loss Rate by Pre-Treatment Performance


*Notes:* Figure illustrates heterogeneous effects of AMI deployment on loss rates by pre-treatment performance. Panel A includes utilities that were above the bottom quartile of the pre-treatment loss rate distribution (i.e., initially poor performers) and Panel B includes utilities that were in the bottom quartile (i.e., initially high performers). Plots provide coefficients  $\beta_j$  and their 95 percent confidence intervals from estimating Equation 1 with our 2SLS estimator, using a one year lead of the AMI treatment variable as the excluded instrument for  $\log(\text{population})$  and omitting the year prior to initial AMI adoption (“-1”). Baseline fixed effects and controls included. Standard errors are clustered at the utility level.

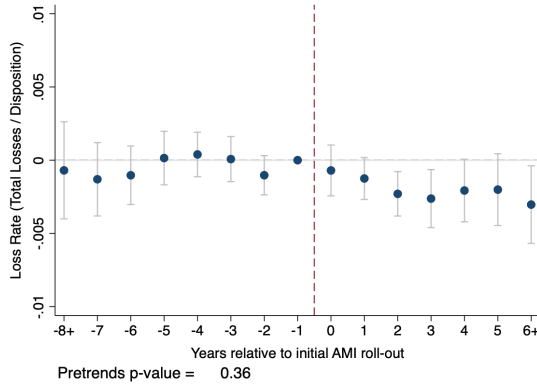


(a) Loss Rate, OLS

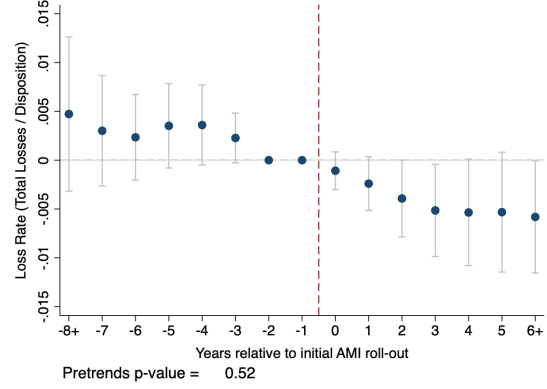

(b) Loss Rate, 2SLS (Main Results)

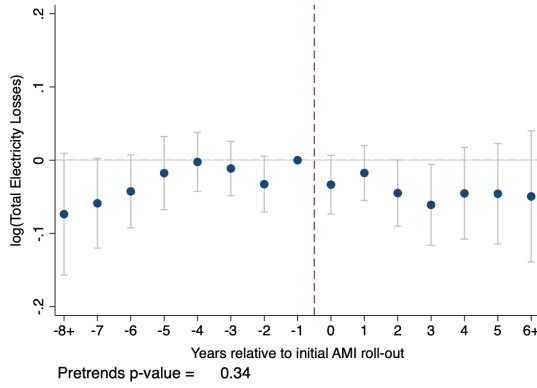


(c) Total Losses, OLS

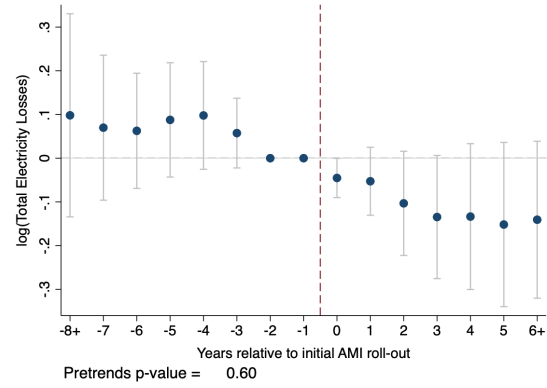

(d) Total Losses, 2SLS


**Figure D4:** Comparison of Results When Using OLS versus 2SLS Augmentation

*Notes:* Figure illustrates the importance of implementing our 2SLS estimator to examine the effects of AMI deployment by comparing the effects on losses when just using OLS (Panels A and C) relative to when using the 2SLS approach (Panels B and D). Plots provide coefficients  $\beta_j$  and their 95 percent confidence intervals from estimating Equation 1, omitting the year prior to initial AMI adoption (“-1”). In Panels B and D, we use a one year lead of the AMI treatment variable as the excluded instrument for log(population). In Panel A, there is a slight pre-trend in loss rates, and since this could be dampened by an opposing pre-trend in total disposition, we also look at total losses and find a stronger pre-trend (Panel C). These pre-trends disappear when using the 2SLS approach. Utility fixed effects, state-year fixed effects, and local market controls are included. Standard errors are clustered at the utility level.

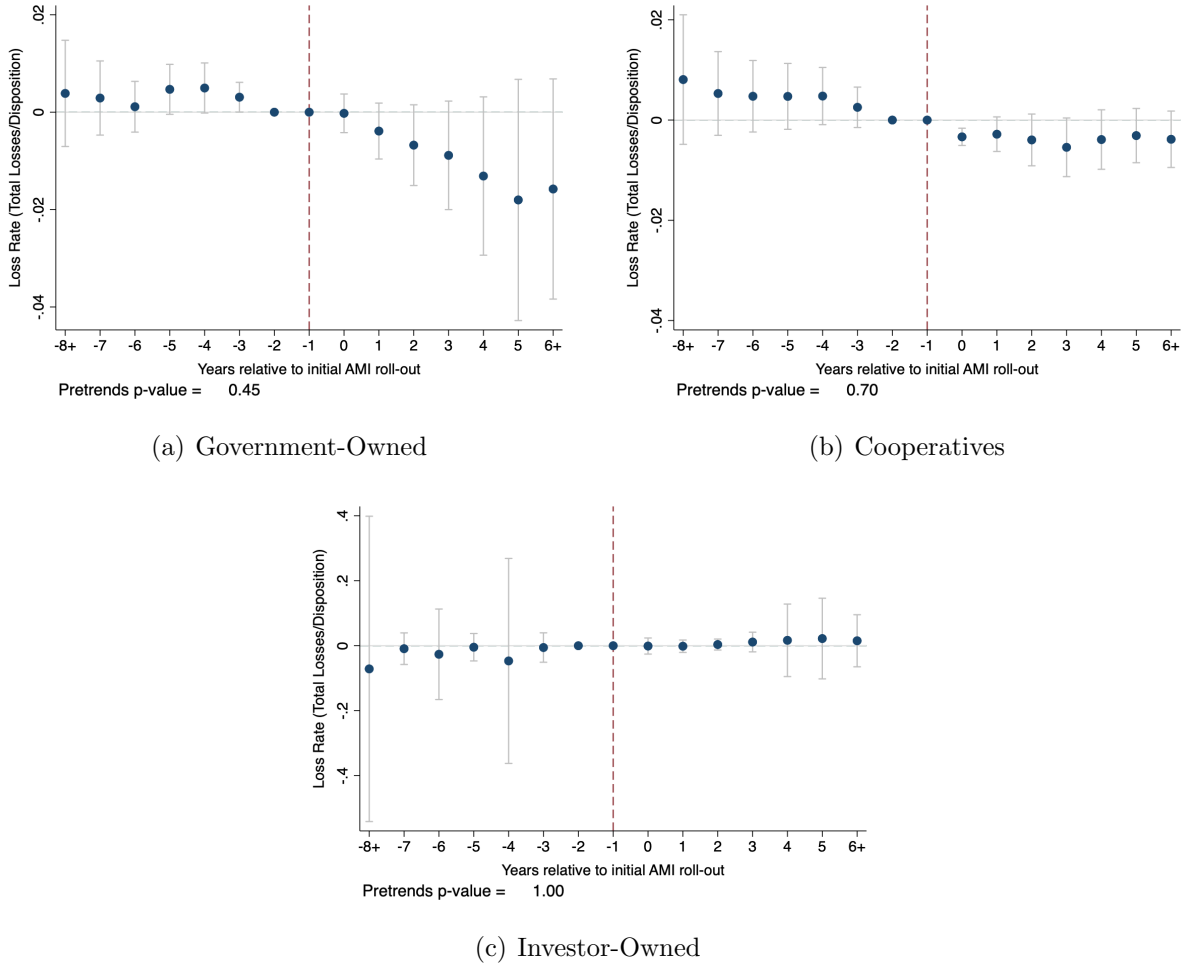

**Figure D5:** Heterogeneous Effects of Smart Meter Deployment on Loss Rate for Comparably-Sized “Smaller” Utilities


*Notes:* Figure plots heterogeneous effects of smart meter deployment on loss rates by utility ownership when omitting “large” investor-owned utilities, defining large as those with a pre-treatment average size exceeding the maximum pre-treatment average size of non-IOWs. The sub-samples for government-owned utilities and cooperatives are thus the same as they are in the main heterogeneity by ownership analysis but the IOU sub-sample omits large IOUs. This provides a sample of comparably-sized utilities. Plots provide coefficients  $\beta_j$  and their 95 percent confidence intervals from estimating Equation 1 with our 2SLS estimator, using a one year lead of the AMI treatment variable as the excluded instrument for  $\log(\text{population})$  and omitting the year prior to initial AMI adoption (“-1”). Utility fixed effects, state-year fixed effects, and local market controls are included. Standard errors are clustered at the utility level.

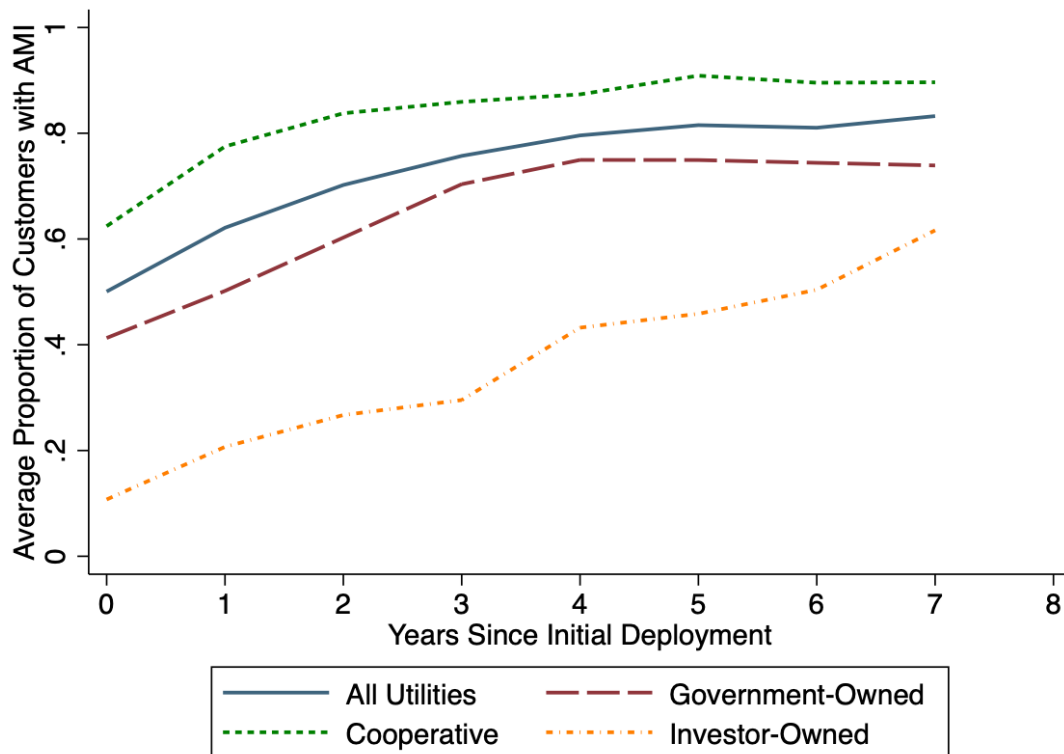


**Figure D6:** Average Proportion of Customers with AMI by Utility Ownership

*Notes:* Figure plots the average proportion of customers with AMI (measured as the number of AMI meters over number of customers within utility) by utility ownership.




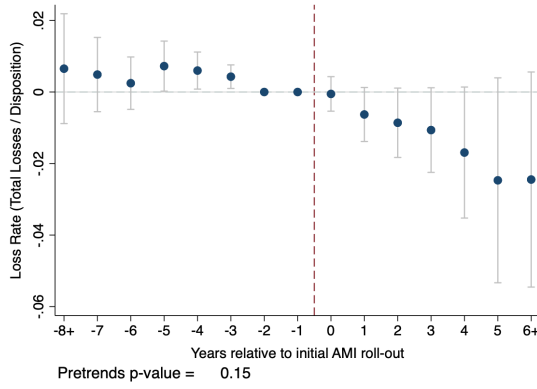


(a) Not Deregulated, Gov-Owned

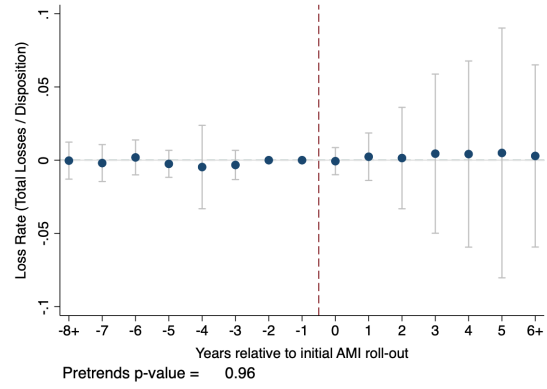


(b) Deregulated, Gov-Owned

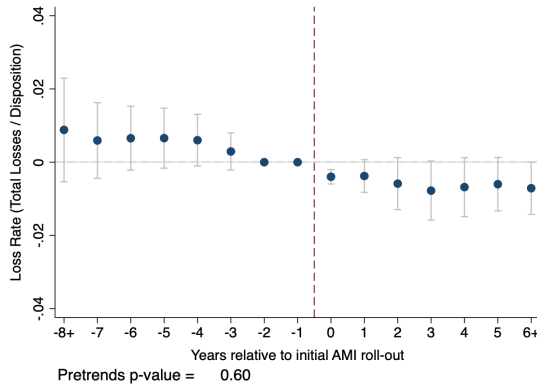


(c) Not Deregulated, Cooperatives

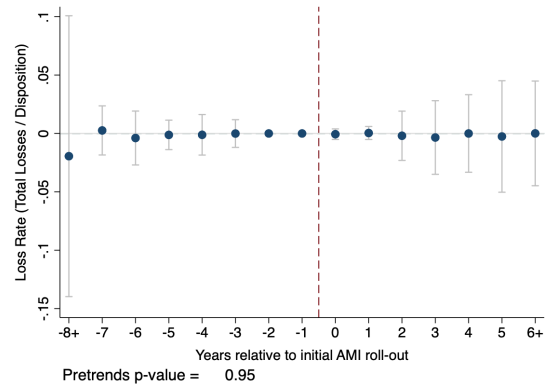

(d) Deregulated, Cooperatives

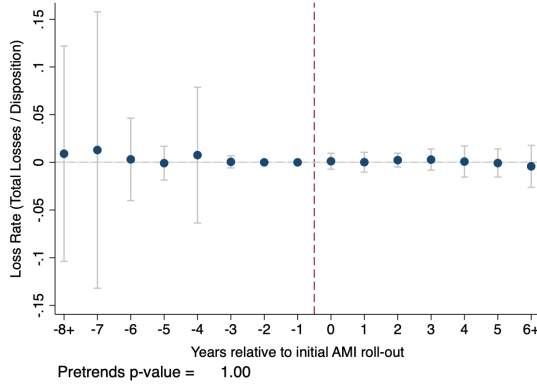


(e) Not Deregulated, IOUs

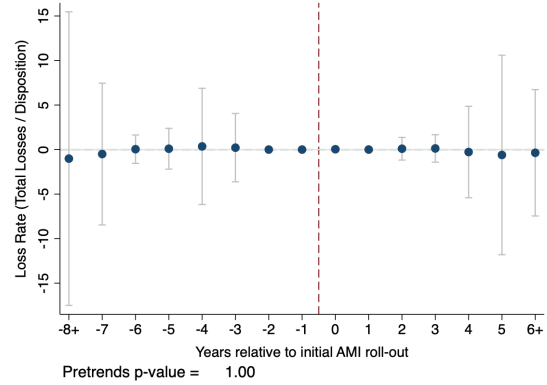


(f) Deregulated, IOUs

**Figure D7: Effects on Loss Rates by Ownership and Electricity Market Deregulation**


*Notes:* Figure plots results for the effect of AMI on loss rates when splitting the sample by utility ownership and whether the utility is located in a state with any electricity market deregulation. Utility fixed effects, state-year fixed effects, and local market controls are included. Standard errors are clustered by utility.

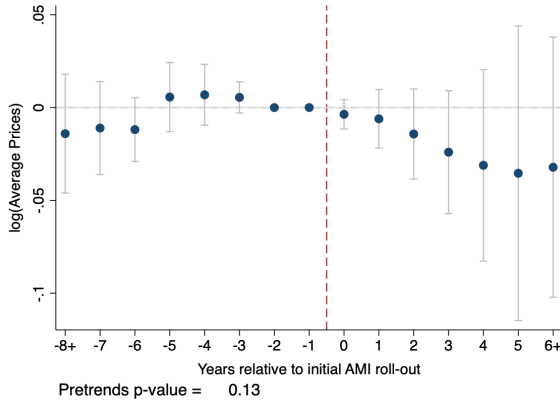

(a) Government-Owned

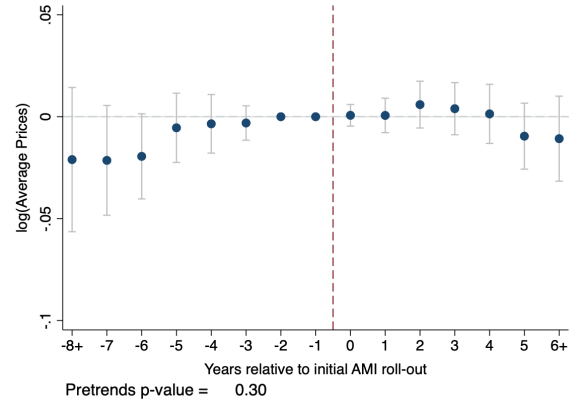

(b) Cooperatives

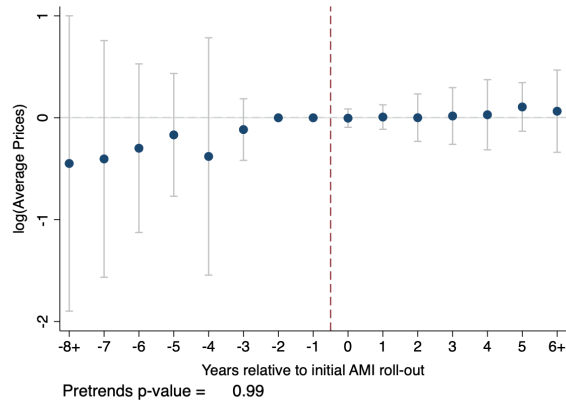

(c) Investor-Owned Utilities (IOUs)

**Figure D8: Effects on Average Prices by Ownership**

*Notes:* Figure plots results for the effect of AMI on (log) average prices by ownership. Utility fixed effects, state-year fixed effects, and local market controls are included. Standard errors are clustered by utility.

## References

- Cooper, Adam and Mike Shuster**, “Electric Company Smart Meter Deployments: Foundation for a Smart Grid (2021 update),” Technical Report, Institute for Electric Innovation, Washington, DC April 2021.
- EIA**, “Smart Grid Legislative and Regulatory Policies and Case Studies,” December 2011.
- , “Electricity Monthly Update,” November 2012.
- , “Today in Energy: Nearly half of all U.S. electricity customers have smart meters -,” December 2017.
- Electric Power Research Institute**, “Methodological Approach for Estimating the Benefits and Costs of Smart Grid Demonstration Projects,” Technical Report 1020342, Electric Power Research Institute, Palo Alto, CA 2010.
- , “Guidebook for Cost/Benefit Analysis of Smart Grid Demonstration Projects: Revision 1, Measuring Impacts and Monetizing Benefits,” Technical Report 1025734, Electric Power Research Institute, Palo Alto, CA 2012.
- Gold, Rachel, Corri Waters, and Dan York**, “Leveraging Advanced Metering Infrastructure To Save Energy,” *American Council for an Energy-Efficient Economy (ACEEE)*, January 2020, *Report U2001*.
- Greenough, J.**, “The Smart Meter Report: Forecasts, regional breakdowns, costs, and savings for a top IoT device,” 2015. Business Insider, April 9, 2015. Available at: <https://www.businessinsider.com/the-smart-meter-report-a-look-at-how-the-smart-meter-market-is-evolving-2015-3#:~:text=The%20cost%20of%20installing%20one,the%20installation%20of%20smart%20meters,AccessedSeptember2023>.
- Guo, Christopher, Craig Bond, and Anu Narayanan**, *The Adoption of New Smart-Grid Technologies: Incentives, Outcomes, and Opportunities*, RAND Corporation, 2015.
- Nangia, Varun, Samuel Oguah, and Kwawu Gaba**, *Can Utilities Realize the Benefits of Advanced Metering Infrastructure?: Lessons from the World Bank’s Portfolio*, World Bank, Washington, DC, July 2016.
- Public Utility Commission of Texas**, “A Report on Advanced Metering as Required by House Bill 2129,” *Report to the 82nd Texas Legislature*, September 2010.
- Southern California Edison**, “TESTIMONY SUPPORTING APPLICATION FOR APPROVAL OF ADVANCED METERING INFRASTRUCTURE PRE-DEPLOYMENT ACTIVITIES AND COST RECOVERY MECHANISM,” December 2006.
- Strong, Derek Ryan**, “The Early Diffusion of Smart Meters in the US Electric Power Industry,” preprint, Thesis Commons April 2018.
- U.S. Department of Energy**, “Reliability Improvements from the Application of Distribution Automated Technologies - Initial Results,” Technical Report 2012.

- , “Smart Grid Investment Program Progress Report,” Technical Report July 2012.
- , “Smart Grid Investments Improve Grid reliability, Resilience and Storm Responses,” Technical Report 2014.
- , “Advanced Metering Infrastructure and Customer Systems: Results from the SGIG Program,” 2016.